


This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.

* Navien Remote required to set Cascade Unit Count Storage Tank with External Circulator Applications

- (A) Tankless Circulator (Bronze or S.S) Selected Shall be 4 GPM Max per Tankless @ 23' Total Head (10 PSI) + pipe, valves, fittings & tank.
- (B) Install Circuit Setters to Maintain Flow into Units @ 4 GPM Maximum.

Storage tank volume size selections:
High Temp (180°F)
 6 X dishwasher GPM requirements
Low Temp (140°F)
 4 X dishwasher GPM requirements

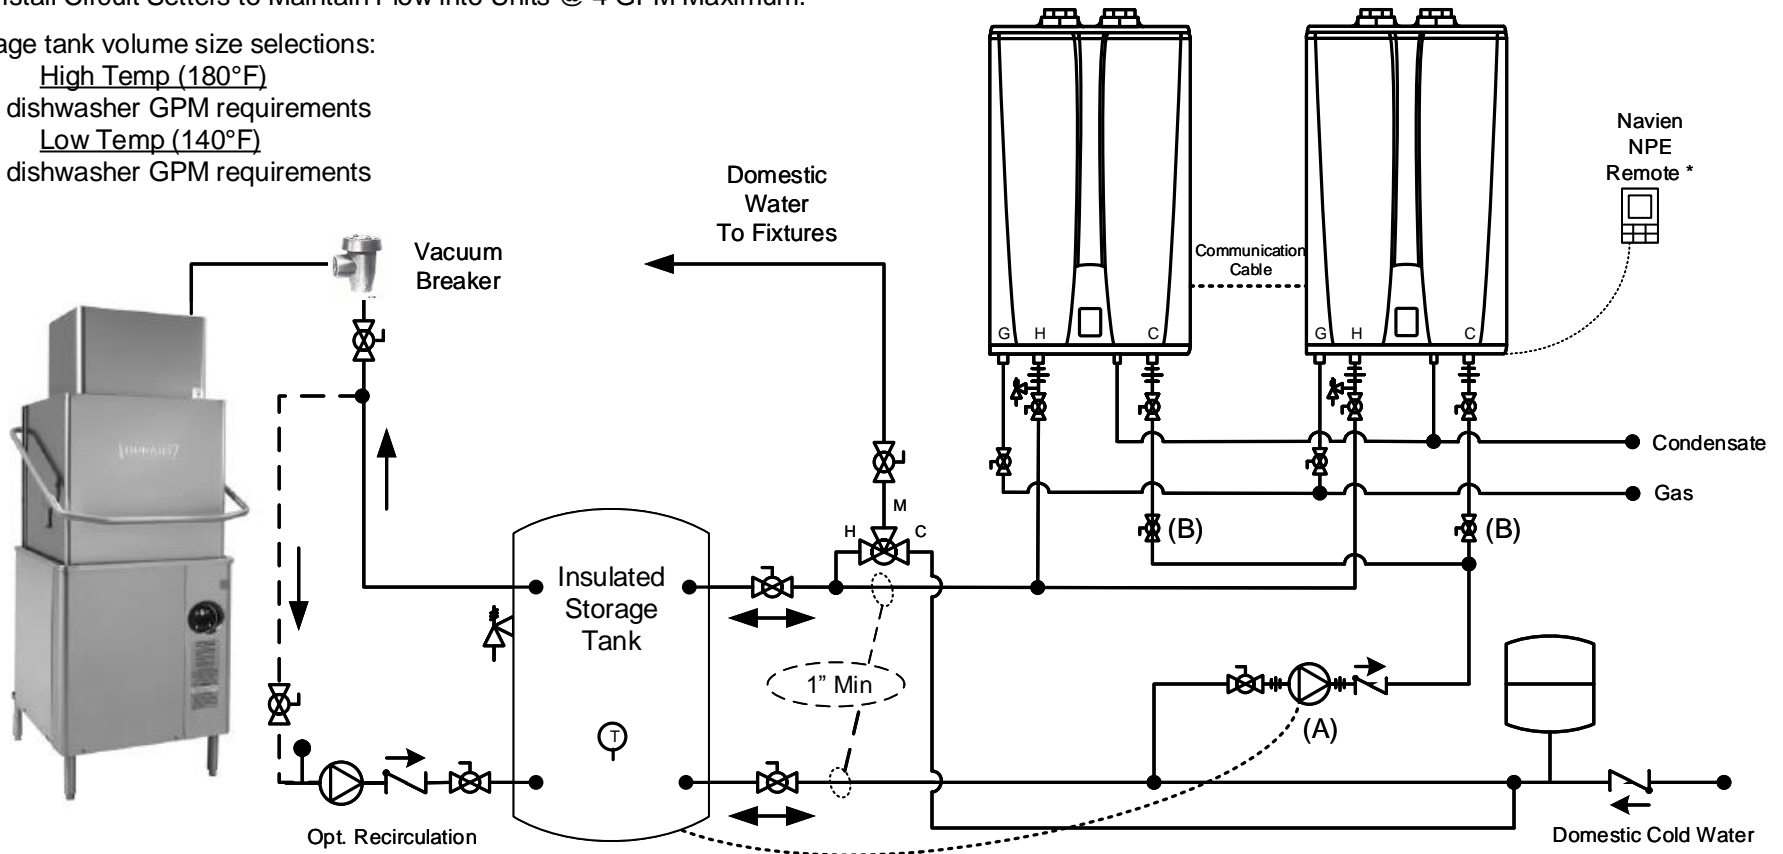

20 Goodyear
 Irvine, CA 92618
 800-519-8794

www.navienamerica.com

NPE-S Series Tankless Water Heater

Two Navien NPE-S Dishwasher Application
 With Storage to meet Flow/Temp
 Rise Requirements

Drawn By: B. Fenske

NPE-S-2-DW-DHW-BF03

April 1, 2017

