


This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.

* Navien Remote required to set Cascade Unit Count Storage Tank with External Circulator Applications

- (A) Tankless Circulator
(Bronze or S.S) Selected Shall be 8 GPM Max (4 Per Tankless)
@ 23' Total Head (10 PSI)
+ pipe, valves, fittings & tank.
- (B) Install Circuit Setters to Maintain Flow into Units @ 4 GPM Maximum

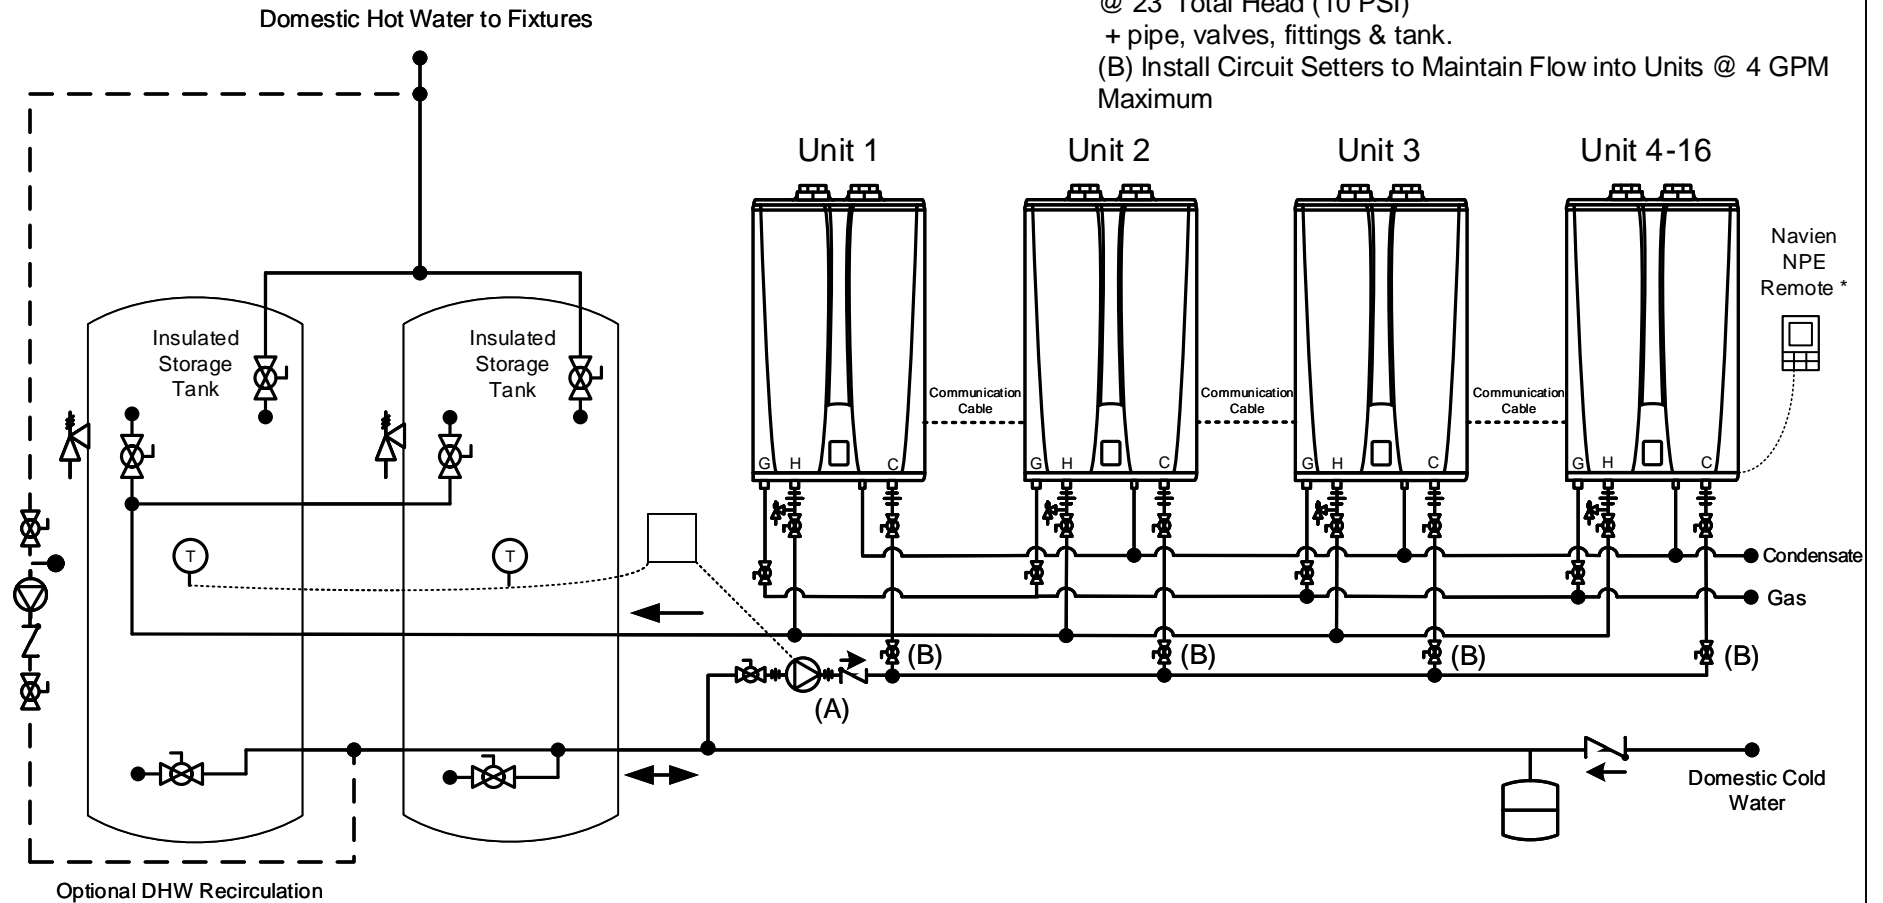

Recommended Pipe Size/Heater Count

1 Unit - ¾"

2 Units - 1"

3 Units - 1-¼"

4 to 5 Units - 1-½"

6 to 8 Units - 2"

9 to 14 Units - 2-½"

15 to 16 Units - 3"

KD NAVIEN

20 Goodyear
Irvine, CA 92618
800-519-8794

www.navienamerica.com

NPE-S Series Tankless Water Heater

Four+ NPE-S with Two Storage Tanks
to meet Flow/Temp Rise Requirements

Drawn By: B. Fenske

NPE-S-4-2ST-BF03

April 1, 2017

