


This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.



Recommended Pipe Size/Heater Count	1 Unit - 3/4"	2 Units - 1"	3 Units - 1-1/4"	4 to 5 Units - 1-1/2"	6 to 8 Units - 2"	9 to 14 Units - 2-1/2"	15 to 16 Units - 3"
------------------------------------	---------------	--------------	------------------	-----------------------	-------------------	------------------------	---------------------

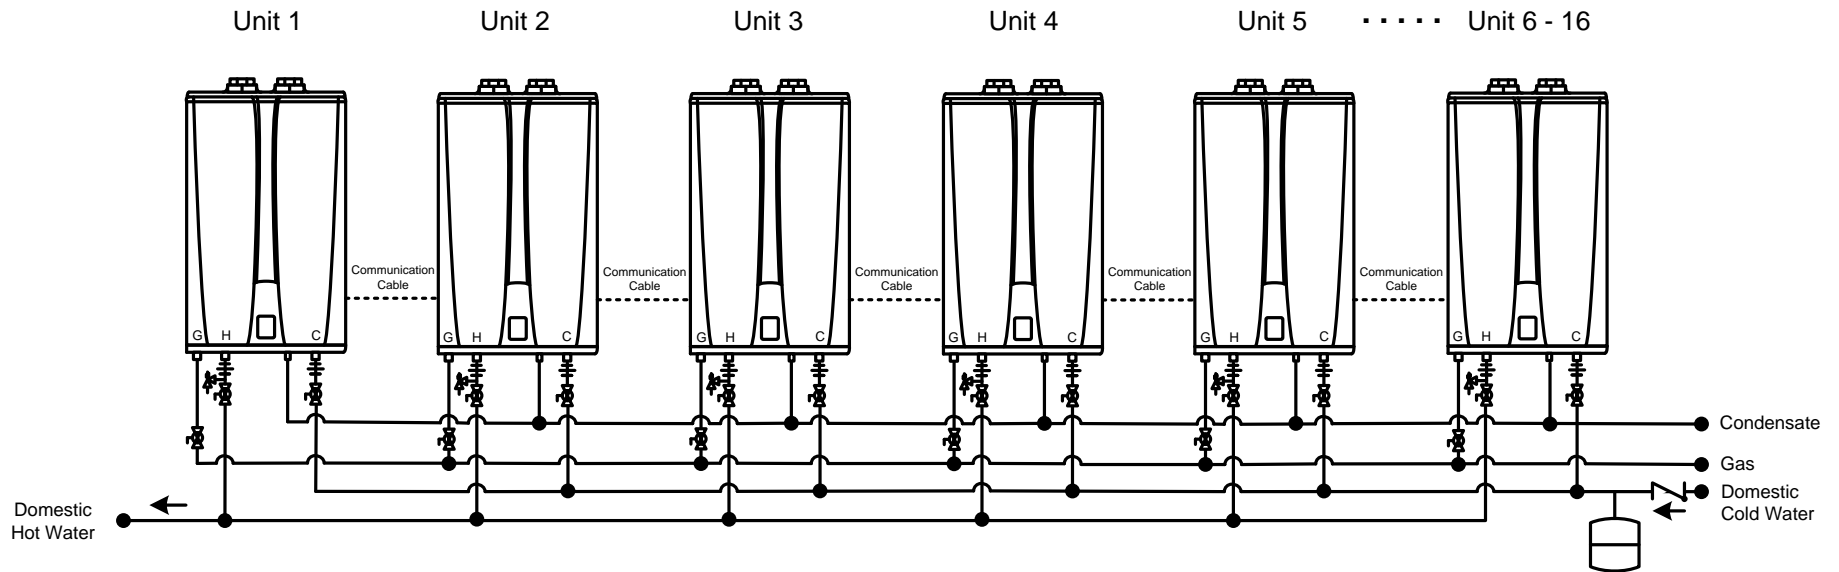

20 Goodyear
Irvine, CA 92618
800-519-8794

www.navienamerica.com

NPE-S Series Tankless Water Heater

**Six Plus NPE-S Tankless
(Includes NPE-A, Internal Circulation Mode)**

Drawn By: B. Fenske

NPE-S-6P-I-BF02

August 1, 2013



Storage Vessel



DHW Circulator
w/Aquastat & Check Valve



Check Valve



Pressure Relief Valve



Mixing Valve



Full-port Ball Valve



Circulator



Expansion Tank



Aquastat