


This drawing is intended only as a guide and not as a replacement for professionally engineered project drawings. This concept system drawing does not imply compliance with local building codes. Actual installation may vary depending on installation location & parameters and it must be done in accordance to all local building codes. Verify with local building officials before commencement of system installation.

- (A) Circulator Requirement:
Bronze or Stainless Steel
Select & Set - 4 GPM max @ 23 ft head.
- (B) Maximum 30 MBTU's/Hour & 135°F
Maximum Heating System Temperature
with NPE tankless set at 140°F.

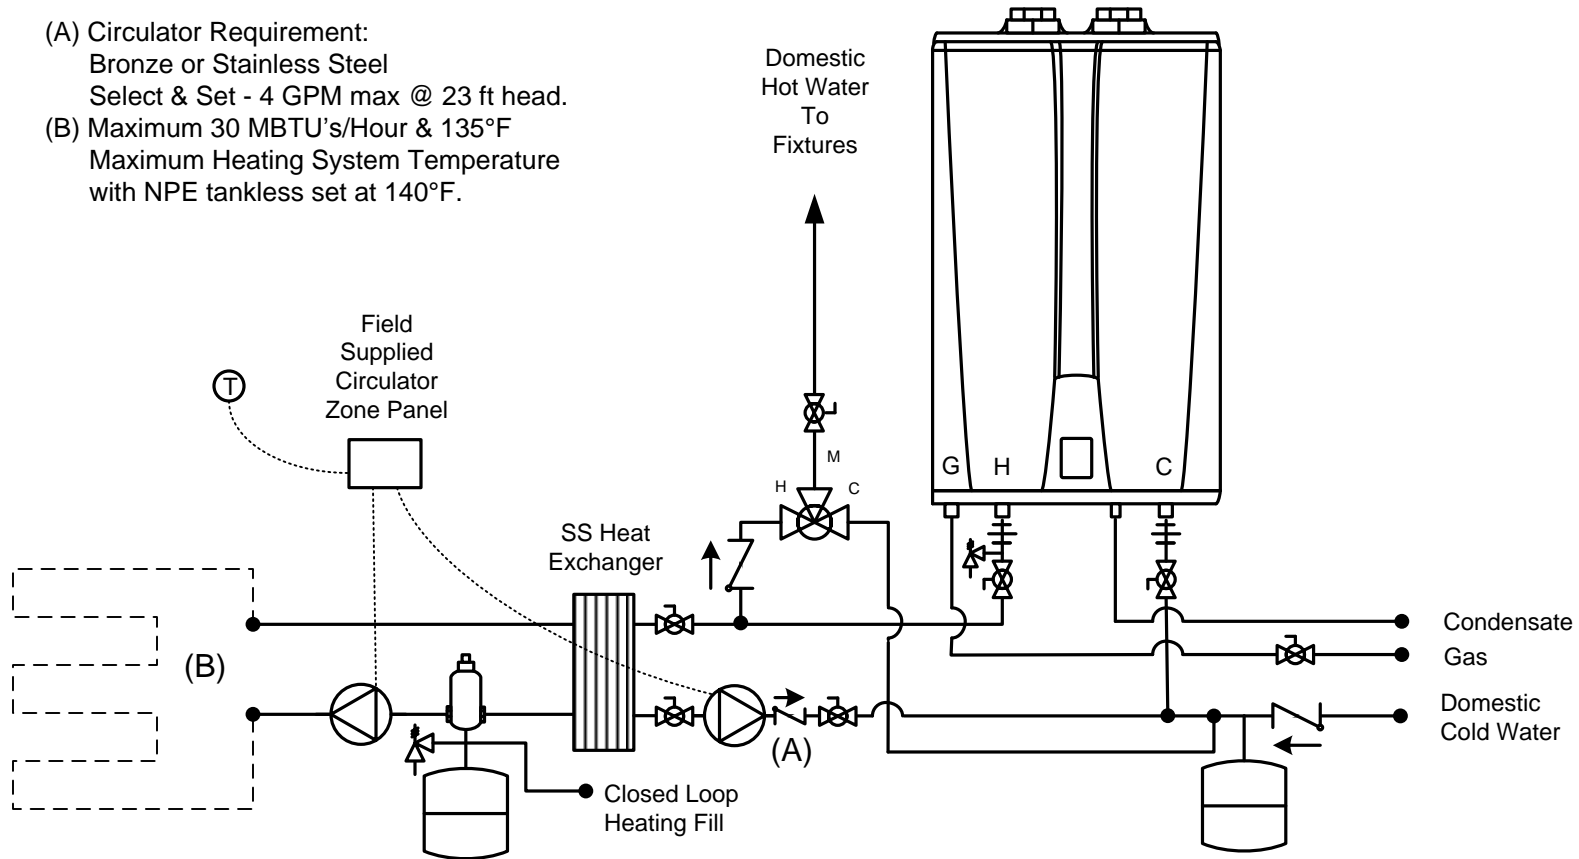

KD Navien

20 Goodyear
Irvine, CA 92618
800-519-8794

www.navienamerica.com

NPE-S Series Tankless Water Heater

Navien NPE-S Series Tankless
Combi Use Application with Required
SS Heat Exchanger

Drawn By: B. Fenske

NPE-S-Combi-SS-BF02

August 1, 2013



Air Elimination



Check Valve



Pressure Relief Valve



Mixing Valve



Full-port Ball Valve



DHW Circulator
w/Aquastat & Check Valve



Circulator



Expansion Tank



Aquastat