


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

FIELD SUPPLIED CIRCULATOR ZONE PANEL SHALL HAVE DRY CONTACTS CLOSED ON HEAT CALLS WIRED TO NAVIEN CH UNIT "T & T" TERMINALS TO ACTIVATE HEAT MODE DIP Sw 7 OF 8 ON PCB

NOTES: UNLESS OTHERWISE SPECIFIED.

1. THE NFC BOILER WILL ACCOMMODATE UP TO 3 ZONE CIRCULATORS, IN ADDITION CIRCULATOR ZONING REQUIREMENTS REQUIRES AN EXTERNAL ZONE CONTROL RELAY.

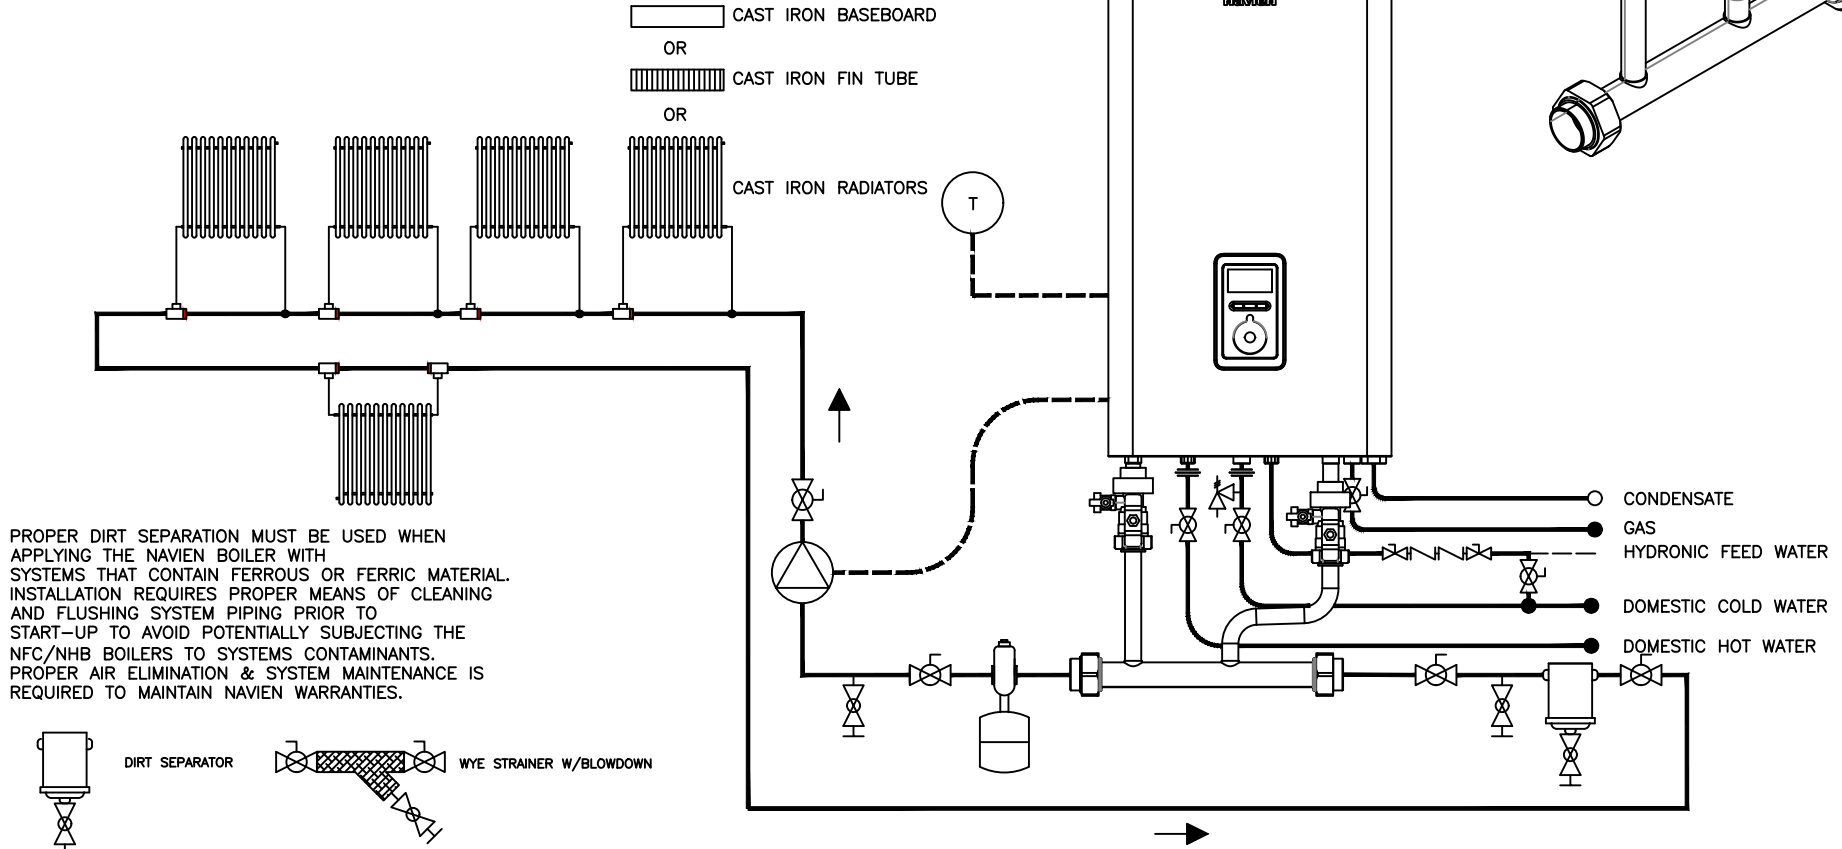

KD Navien

20 GOODYEAR
IRVINE, CA 92618
800-519-8794
www.navien.inc

NFC-SERIES COMBI-BOILER

NAVIEN NFC COMBI BOILER CI SYSTEM
WITH MONOFLOW PIPING

DRAWN BY:

J.G.

NFC-CI-PM-MONO-JG01

DEC 26, 2018

| | | | |
|---|--------------|-----------------------|-------------------------|
| AIR ELIMINATION | CHECK VALVE | FULL-PORT BALL VALVE | AQUASTAT |
| DIRT SEPARATOR | ZONE VALVE | PRESSURE RELIEF VALVE | CIRCULATOR |
| DHW CIRCULATOR W/AQUASTAT & CHECK VALVE | MIXING VALVE | EXPANSION TANK | PURGE VALVE MONOFLO TEE |
| | | | BACKFLOW PREVENTER |