


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS  
 THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY  
 DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES.  
 VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.



RECOMMENDED PIPE SIZE/HEATER COUNT

1 UNIT - 3/4"	2 UNIT - 1"	3 UNIT - 1-3/4"	4 TO 5 UNITS - 1-1/2"	6 TO 8 UNITS - 2"	9 TO 14 UNITS - 2-1/2"	15 TO 16 UNITS - 3"
---------------	-------------	-----------------	-----------------------	-------------------	------------------------	---------------------

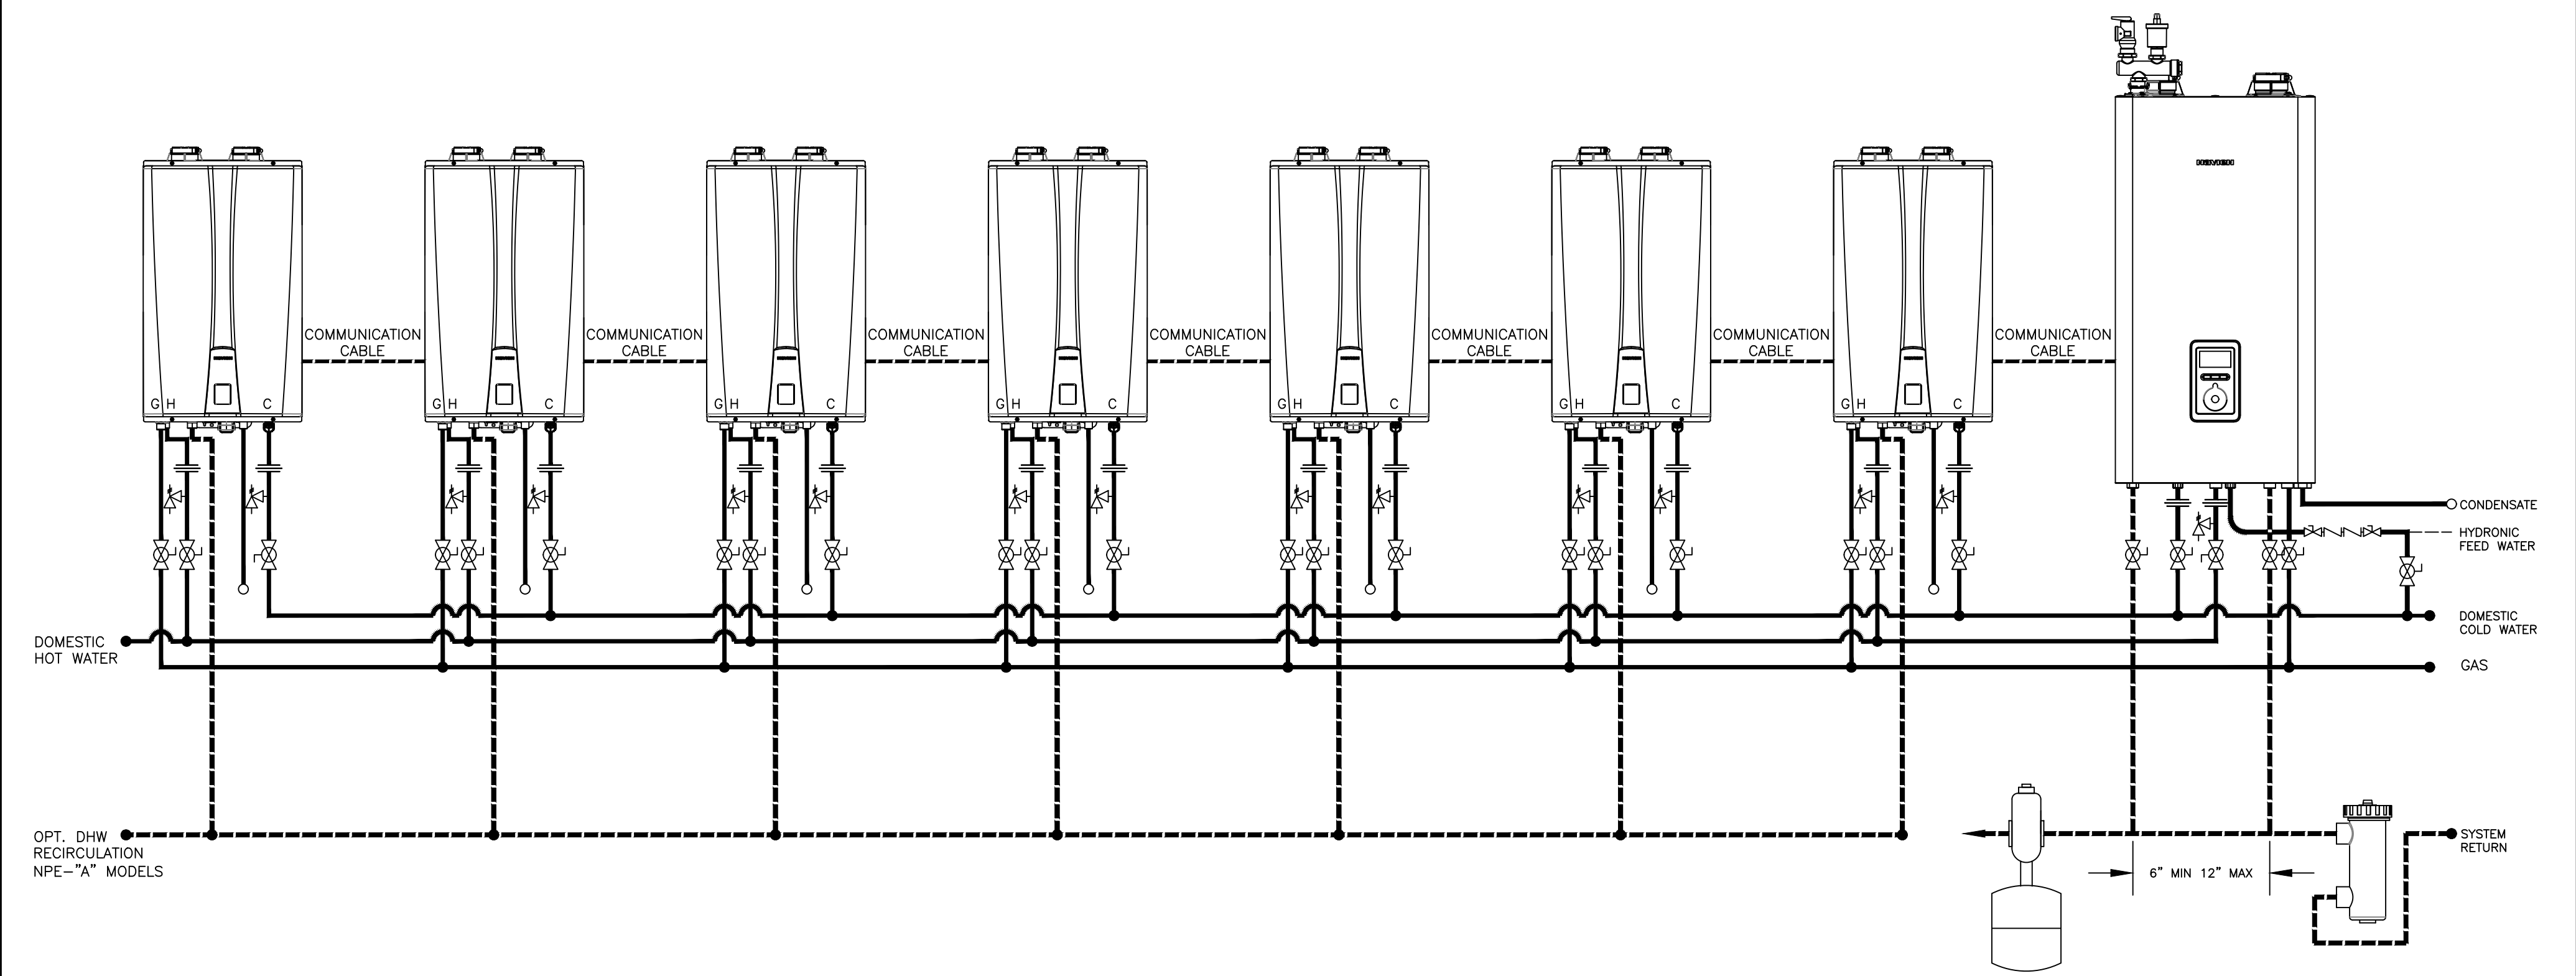

20 GOODYEAR  
 IRVINE, CA 92618  
 800-519-8794  
 www.navieninc.com

NFC-E SERIES COMBI-BOILER & NPE (A/S) SERIES TANKLESS  
 NAVIEN NFC COMBI BOILER WITH SEVEN NPE A/S  
 TANKLESS WATER HEATER

DRAWN BY: J.GARCIA

NFC-E-7NPE-JG01 MAY 09, 2019

AIR ELIMINATION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
ZONE VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	BACKFLOW PREVENTER
DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	MIXING VALVE	EXPANSION TANK	SOLENOID VALVE