


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

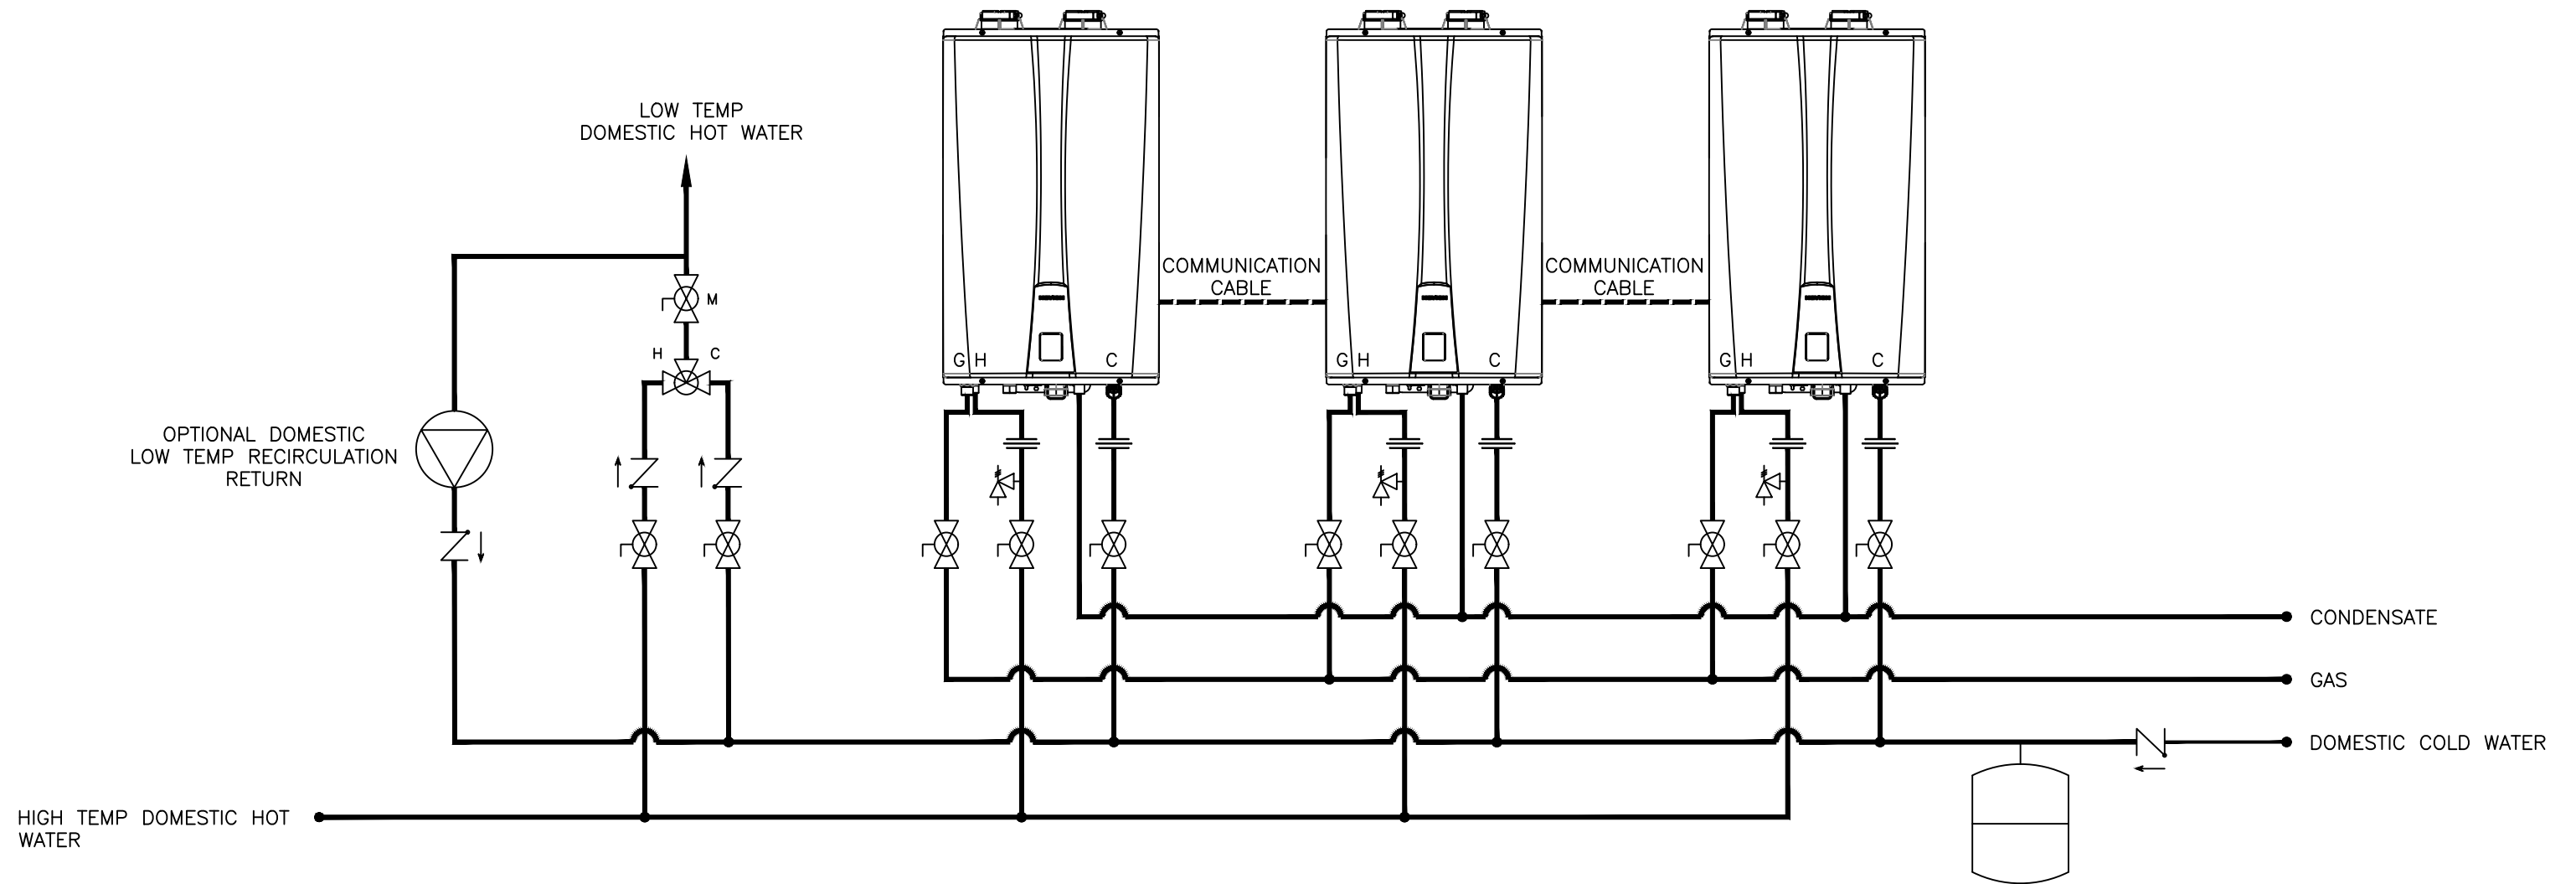

RECOMMENDED PIPE SIZE/HEATER COUNT

1 UNIT - 3/4"

2 UNIT - 1"

3 UNIT - 1-3/4"

4 TO 5 UNITS - 1-1/2"

6 TO 8 UNITS - 2"

9 TO 14 UNITS - 2-1/2"

15 TO 16 UNITS - 3"

KD Navien

20 GOODYEAR
IRVINE, CA 92618
800-519-8794
www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER

THREE NPE-S TANKLESS DOMESTIC
EXTERNAL RECIRCULATION MODE WITH THERMOSTATIC
MIXING VALVE

DRAWN BY:

J.GARCIA

NPE-S-3-E-MV-JG01

JULY 16, 2019



AIR
ELIMINATION



CHECK
VALVE



FULL-PORT
VALVE



AQUASTAT



ZONE
VALVE



PRESSURE
RELIEF
VALVE



CIRCULATOR



BACKFLOW
PREVENTOR



DHW CIRCULATOR
W/AQUASTAT &
CHECK VALVE



MIXING
VALVE



EXPANSION
TANK



SOLENOID
VALVE