


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

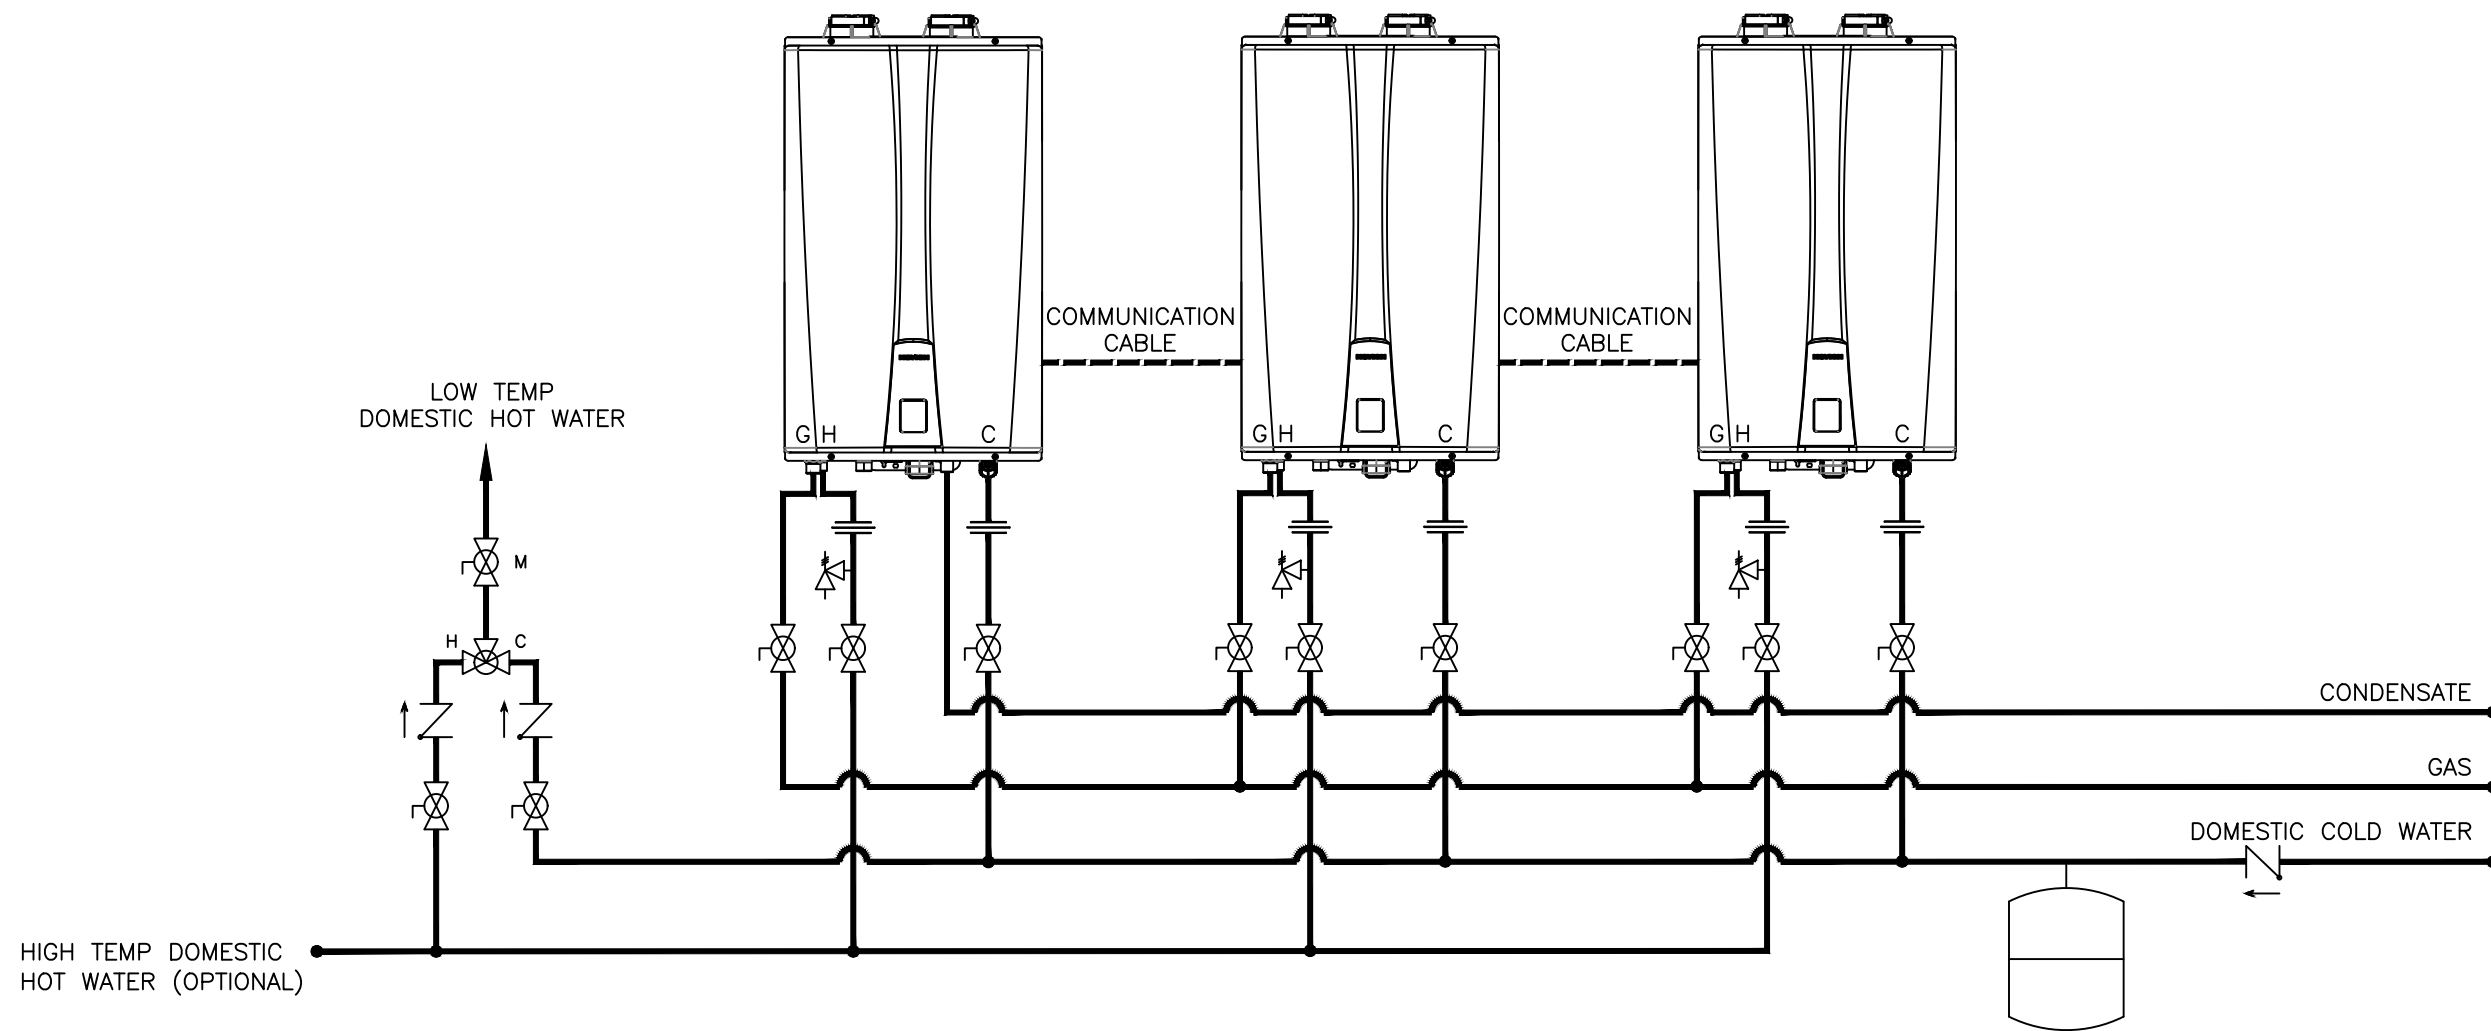

RECOMMENDED PIPE SIZE/HEATER COUNT

1 UNIT - 3/4"

2 UNIT - 1"

3 UNIT - 1-3/4"

4 TO 5 UNITS - 1-1/2"

6 TO 8 UNITS - 2"

9 TO 14 UNITS - 2-1/2"

15 TO 16 UNITS - 3"



20 GOODYEAR  
IRVINE, CA 92618  
800-519-8794  
www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER  
  
THREE NPE-S TANKLESS  
WITH TWO TEMPERATURE OPERATION

DRAWN BY: J.GARCIA

NPE-S-3LT-I-JG01

JULY 16, 2019

	AIR ELIMINATION		CHECK VALVE		FULL-PORT VALVE		AQUASTAT
	ZONE VALVE		PRESSURE RELIEF VALVE		CIRCULATOR		BACKFLOW PREVENTOR
	DHW CIRCULATOR W/AQUASTAT & CHECK VALVE		MIXING VALVE		EXPANSION TANK		SOLENOID VALVE