


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

NOTE:
 APPLICATIONS WITH A MIXTURE OF NAVIEN NPE-A (CIRCULATION) & NPE-S (STANDARD)
 THE FOLLOWING SHOULD FOLLOWED:

1. 50% OF TANKLESS UNITS SHALL BE NPE-A MODELS.
2. MINIMUM OF 2 NPE-A (2 OF 3-4, 3 OF 6).

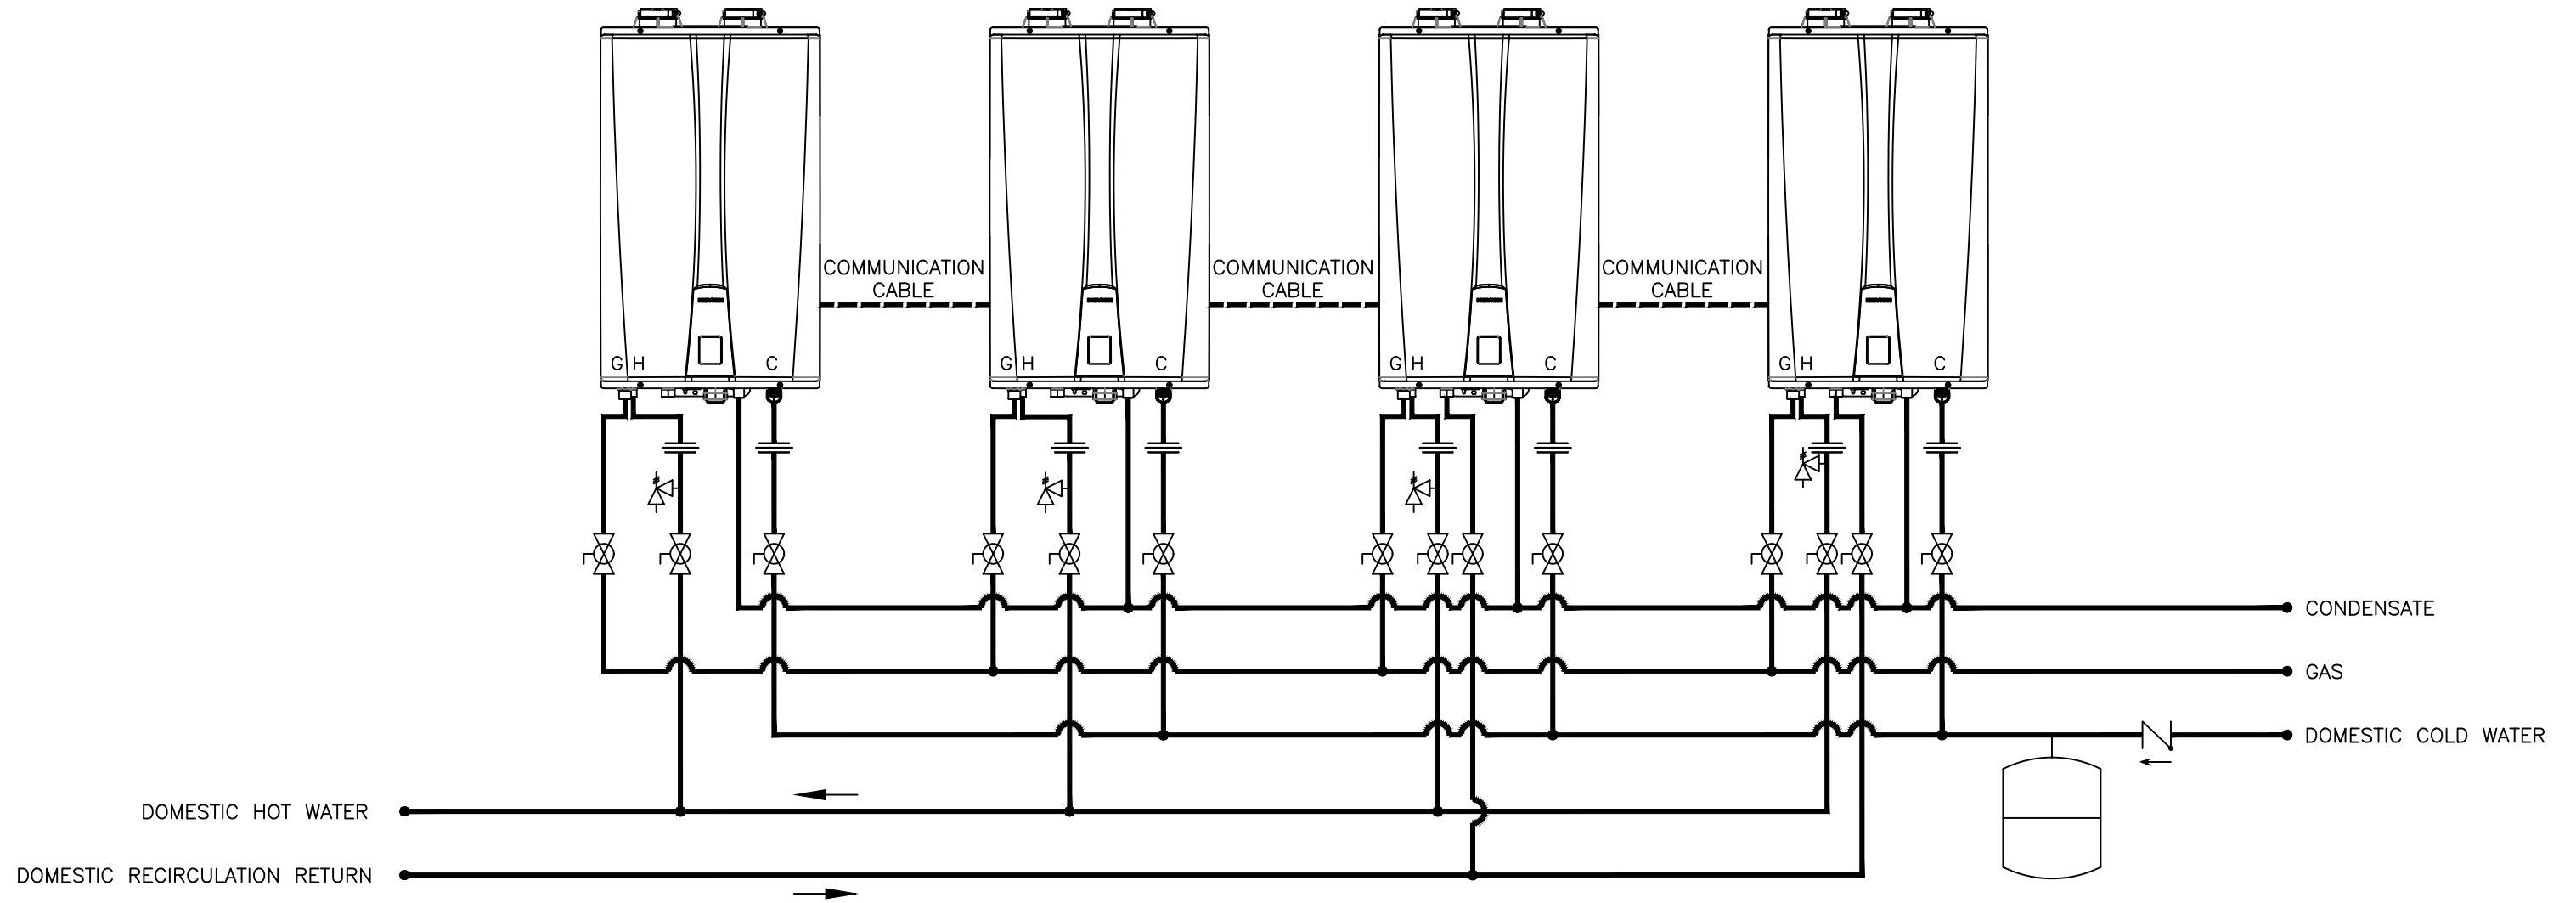

RECOMMENDED PIPE SIZE/HEATER COUNT

1 UNIT - 3/4"

2 UNIT - 1"

3 UNIT - 1-3/4"

4 TO 5 UNITS - 1-1/2"

6 TO 8 UNITS - 2"

9 TO 14 UNITS - 2-1/2"

15 TO 16 UNITS - 3"

KD Navien

20 GOODYEAR
 IRVINE, CA 92618
 800-519-8794
 www.navieninc.com

NPE-A/S SERIES TANKLESS WATER HEATER

FOUR NPE-A/NPE-S TANKLESS
 EXTERNAL RECIRCULATION MODE

DRAWN BY:

J.GARCIA

NPE-A-S-4-E-JG03

JULY 12, 2019

	AIR ELIMINATION		CHECK VALVE		FULL-PORT VALVE		AQUASTAT
	ZONE VALVE		PRESSURE RELIEF VALVE		CIRCULATOR		BACKFLOW PREVENTOR
	DHW CIRCULATOR W/AQUASTAT & CHECK VALVE		MIXING VALVE		EXPANSION TANK		SOLENOID VALVE