


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

(A) CIRCULATOR REQUIREMENT: BRONZE OR STAINLESS STEEL SELECT & SET - 4 GPM MAX @ 23 ft HEAD

(B) MAXIMUM 30 MBTU'S/HOUR & 135°F MAXIMUM HEATING SYSTEM TEMPERATURE WITH NPE TANKLESS SET AT 140°F.

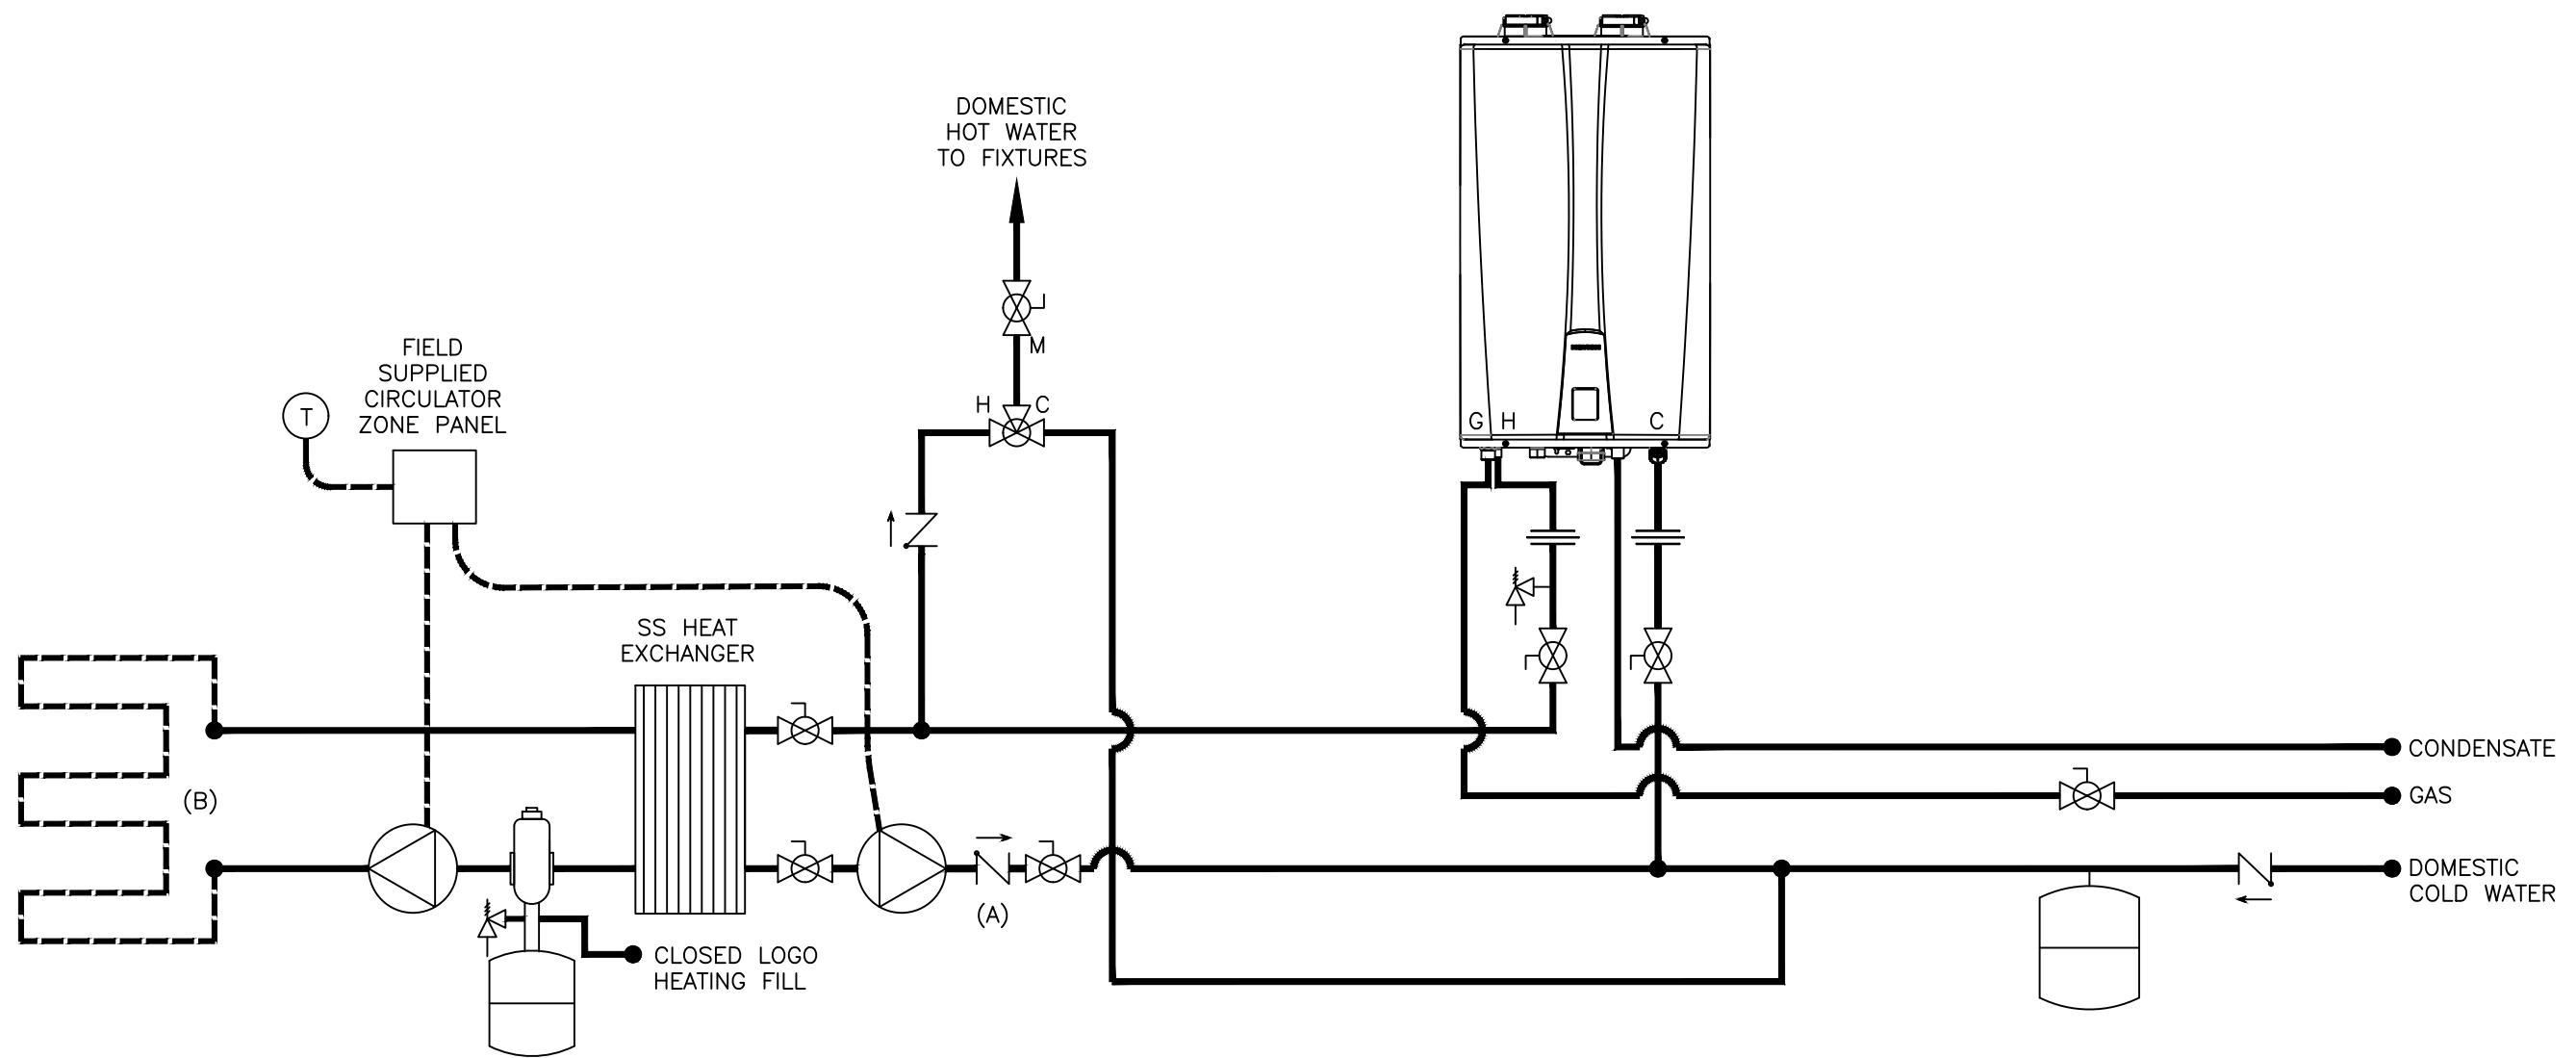

KD Navien
 20 GOODYEAR
 IRVINE, CA 92618
 800-519-8794
 www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER

NAVIENT NPE-S SERIES TANKLESS COMBI USE APPLICATION WITH REQUIRED SS HEAT EXCHANGER

DRAWN BY: J.GARCIA NPE-S-COMBI-SS-JG03 JULY 25, 2019

	AIR ELIMINATION		CHECK VALVE		FULL-PORT VALVE		AQUASTAT
	ZONE VALVE		PRESSURE RELIEF VALVE		CIRCULATOR		BACKFLOW PREVENTOR
	DHW CIRCULATOR W/AQUASTAT & CHECK VALVE		MIXING VALVE		EXPANSION TANK		SOLENOID VALVE