


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

- NOTES:
1. FOR STORAGE TANK/GEOTHERMAL OPERATION; DIP SWITCH #6 OF 10 LOCATED ON INTEGRATED DISPLAY PANEL SHOULD BE SET ON (UP).
  2. WITH STORAGE TANK/GEOTHERMAL OPERATION ENABLED, NPE TANKLESS DHW SETTINGS MAYBE BE SET AT OR NEAR STORAGE TANK THERMOSTATIC MIXING VALVE TEMPERATURE OUTPUT.

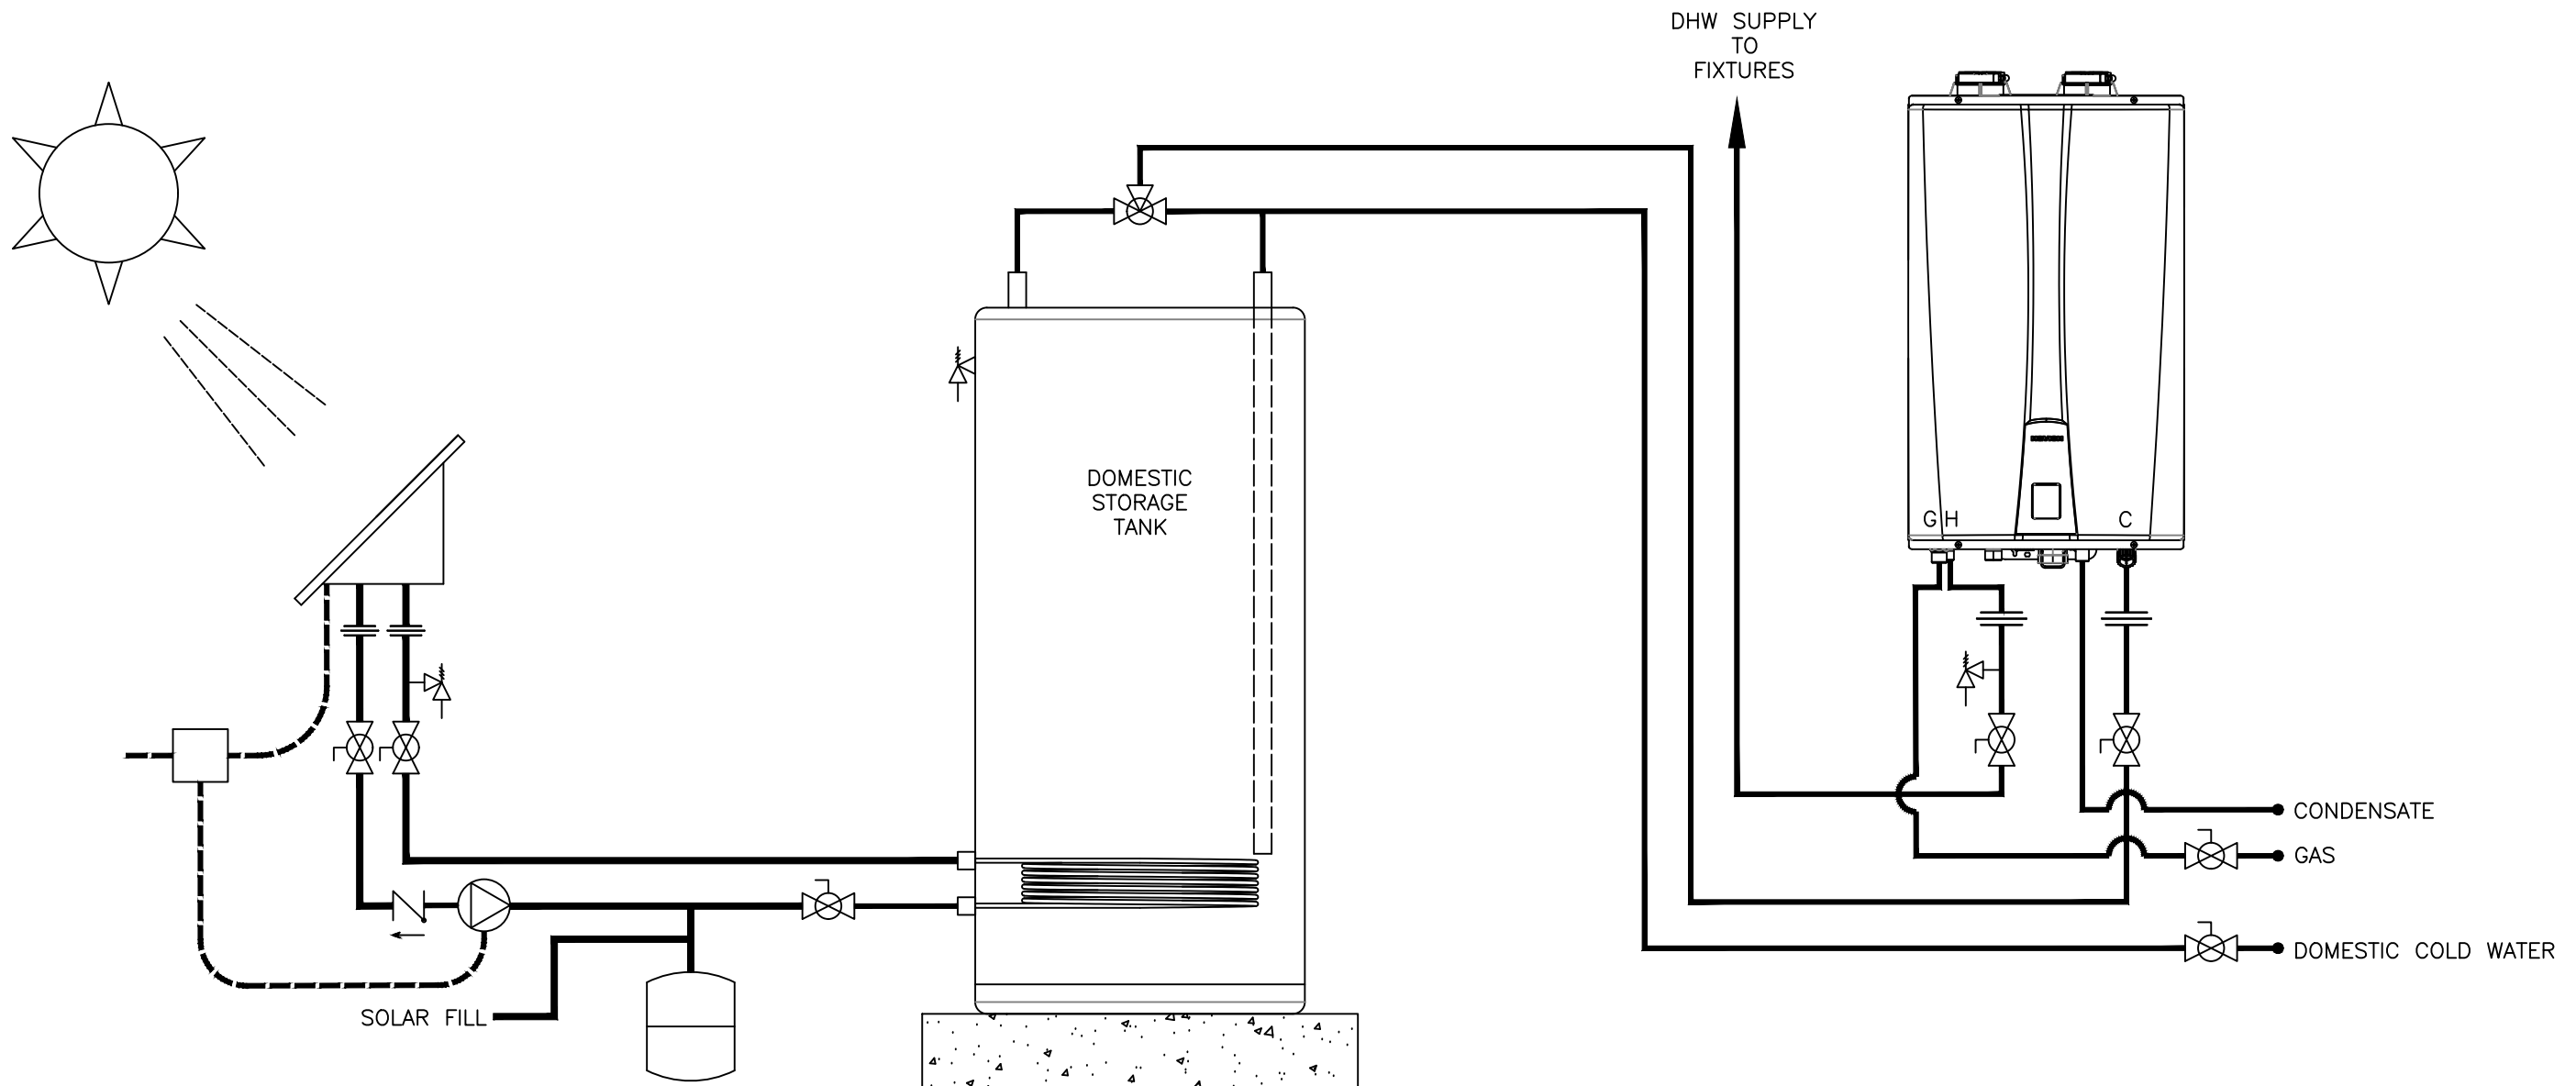

**KD Navien**  
 20 GOODYEAR  
 IRVINE, CA 92618  
 800-519-8794  
 www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER

NPE-S DOMESTIC HOT WATER STANDARD  
 INSTALLATION WITH GEOTHERMAL OR DESUPERHEATER

DRAWN BY: J.GARCIA      NPE-S-S-JG03      JULY 19, 2019

	AIR ELIMINATION		CHECK VALVE		FULL-PORT VALVE		AQUASTAT
	ZONE VALVE		PRESSURE RELIEF VALVE		CIRCULATOR		BACKFLOW PREVENTOR
	DHW CIRCULATOR W/AQUASTAT & CHECK VALVE		MIXING VALVE		EXPANSION TANK		SOLENOID VALVE