


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

RECOMMENDED SYSTEM & HEADER PIPE SIZES - TOTAL BTU (>4 Ft/Sec.) 1 1/2" - UP 301,000 BTU'S (1 BOILER) 2" - 399,000 BTU'S (1 BOILERS) 2 1/2" - 601,000 TO 798,000 BTU'S (2 BOILERS) 3" - 903,000 TO 1,197,000 BTU'S (3 BOILERS) 4" - 1,204,000 TO 3,192,000 BTU'S (4 TO 8 BOILERS)

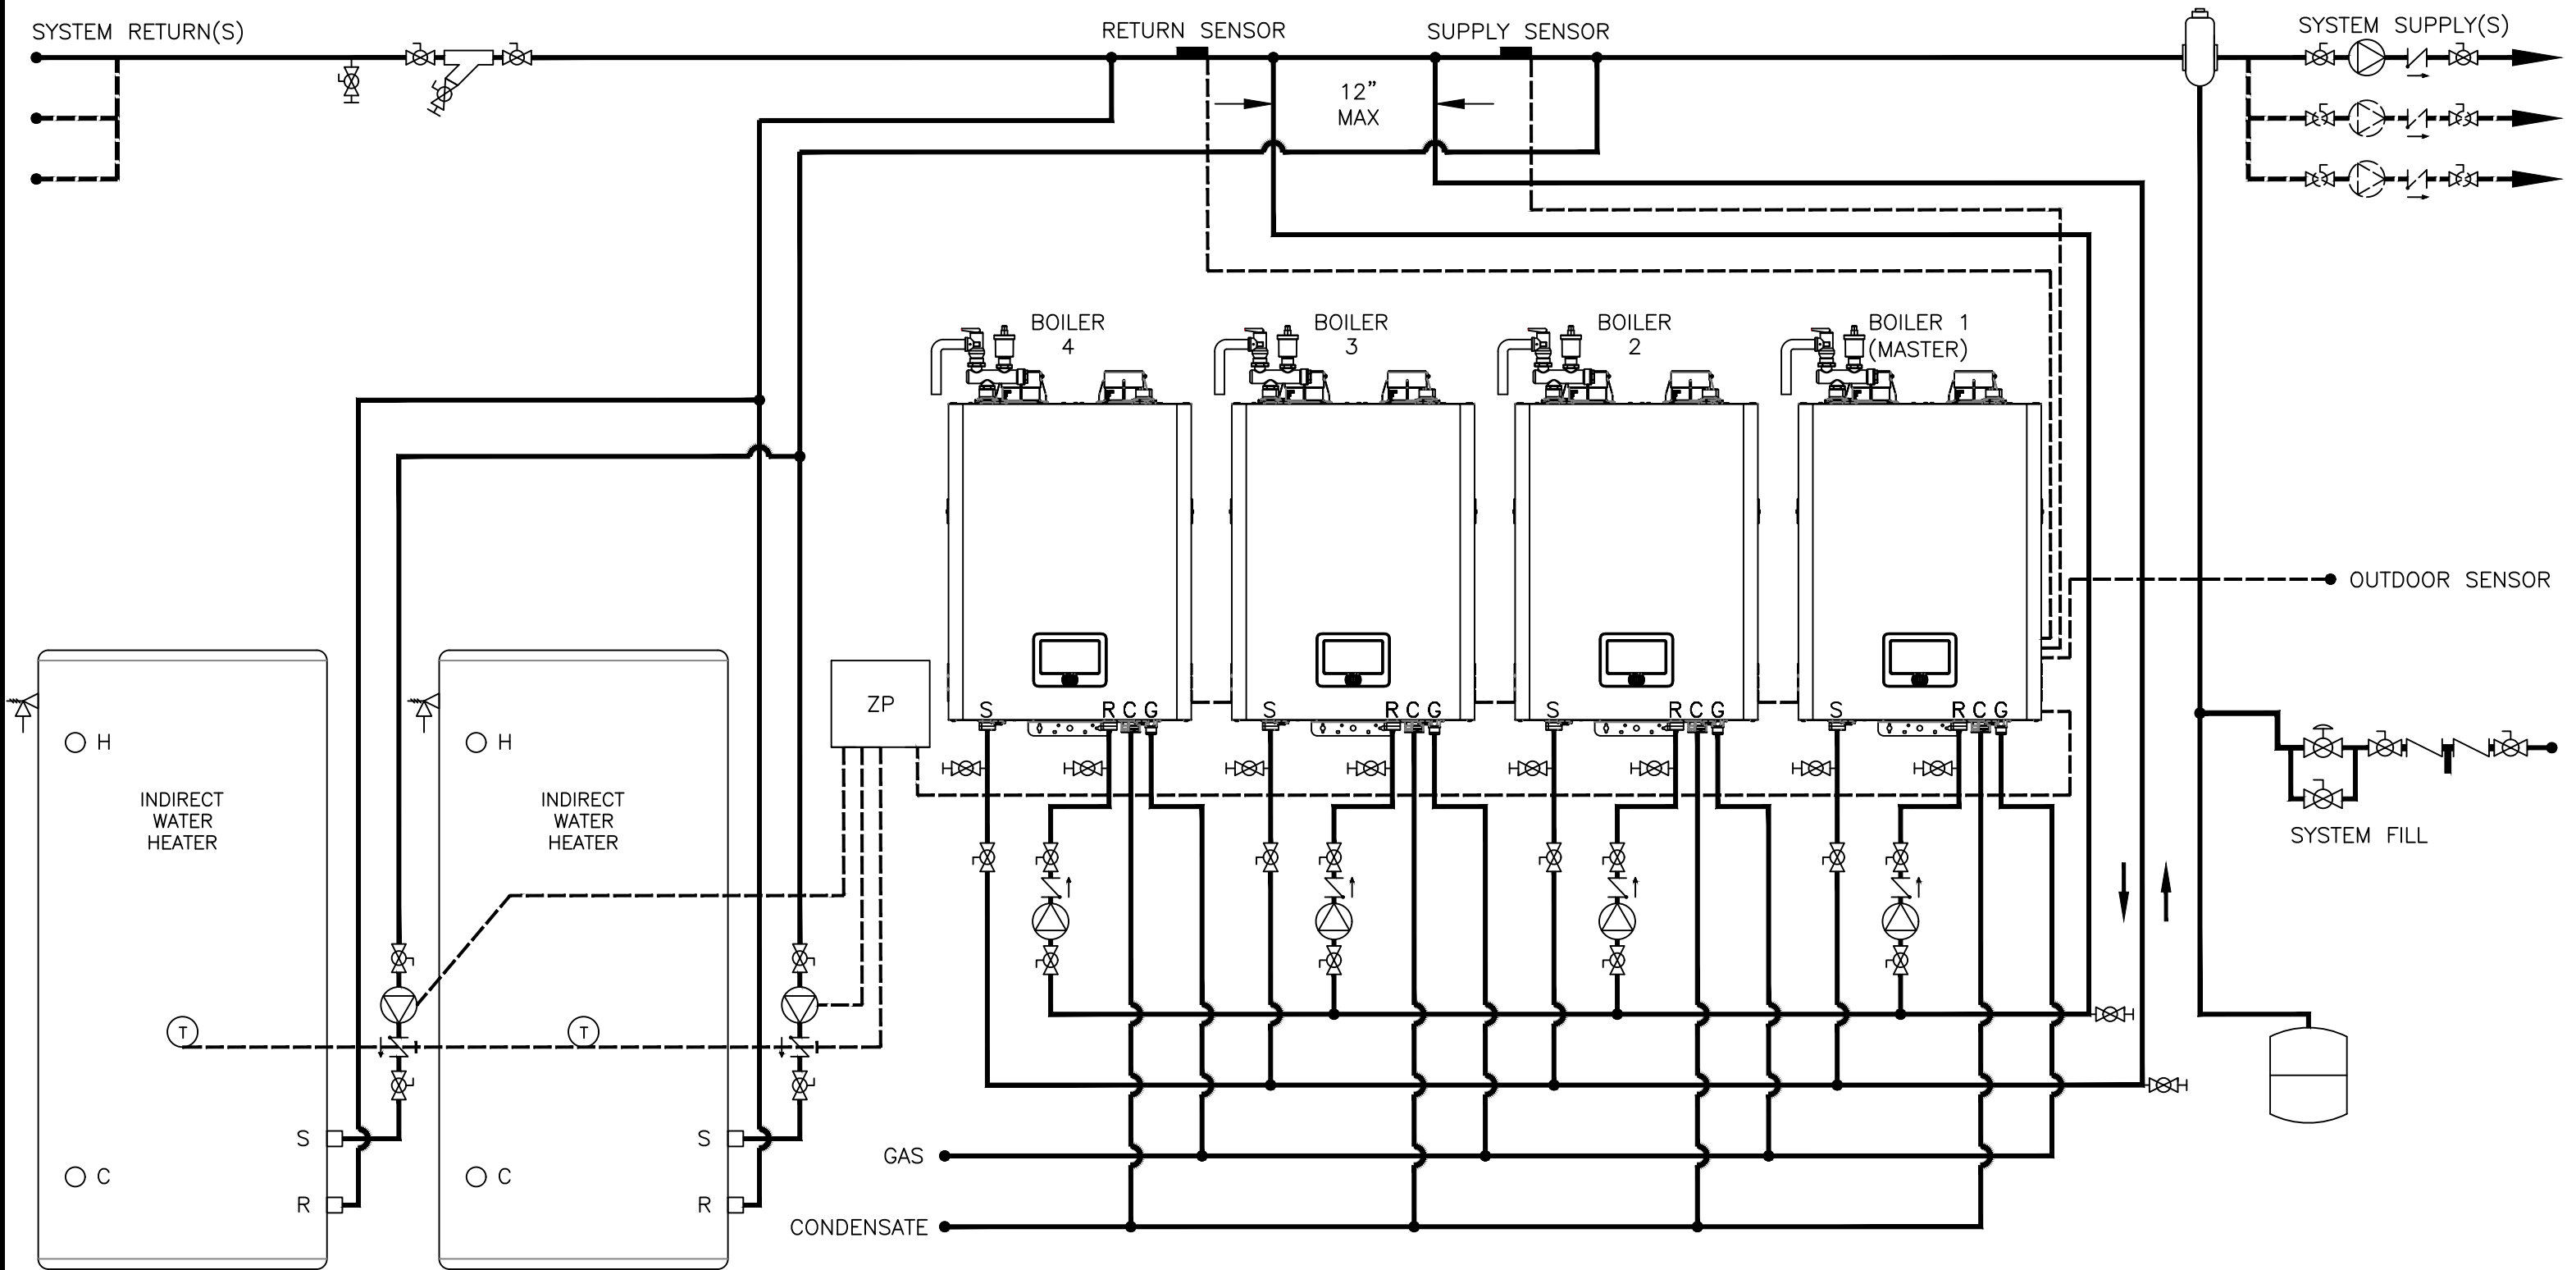

-- NAVIEN COMMUNICATION CABLE (1 LESS THAN TOTAL BOILER COUNT REQUIRED)

KD Navien
 20 GOODYEAR
 IRVINE, CA 92618
 800-519-8794
 www.navieninc.com

NFB-C SERIES CONDENSING-BOILER

NAVIEN NFB-C 301/399 FOUR MULTIPLE BOILER APPLICATION WITH TWO INDIRECT WATER HEATER COMMON SECONDARY INJECTION PIPING

DRAWN BY: J.GARCIA NFB-C-301-399-4MULT-C-2IND-JG01 OCT 16, 2019

AIR ELIMINATION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
ZONE VALVE	BALL VALVE DRAIN	CIRCULATOR	BACKFLOW PREVENTOR
DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	MIXING VALVE	EXPANSION TANK	SOLENOID VALVE