


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

USING EXISTING AIR HANDLER INTERNAL CIRCULATOR  
 NAVIEN NPE INTERNAL CIRCULATOR MUST BE  
 PROGRAMMED FOR  
 "INTERNAL CIRCULATION MODE"

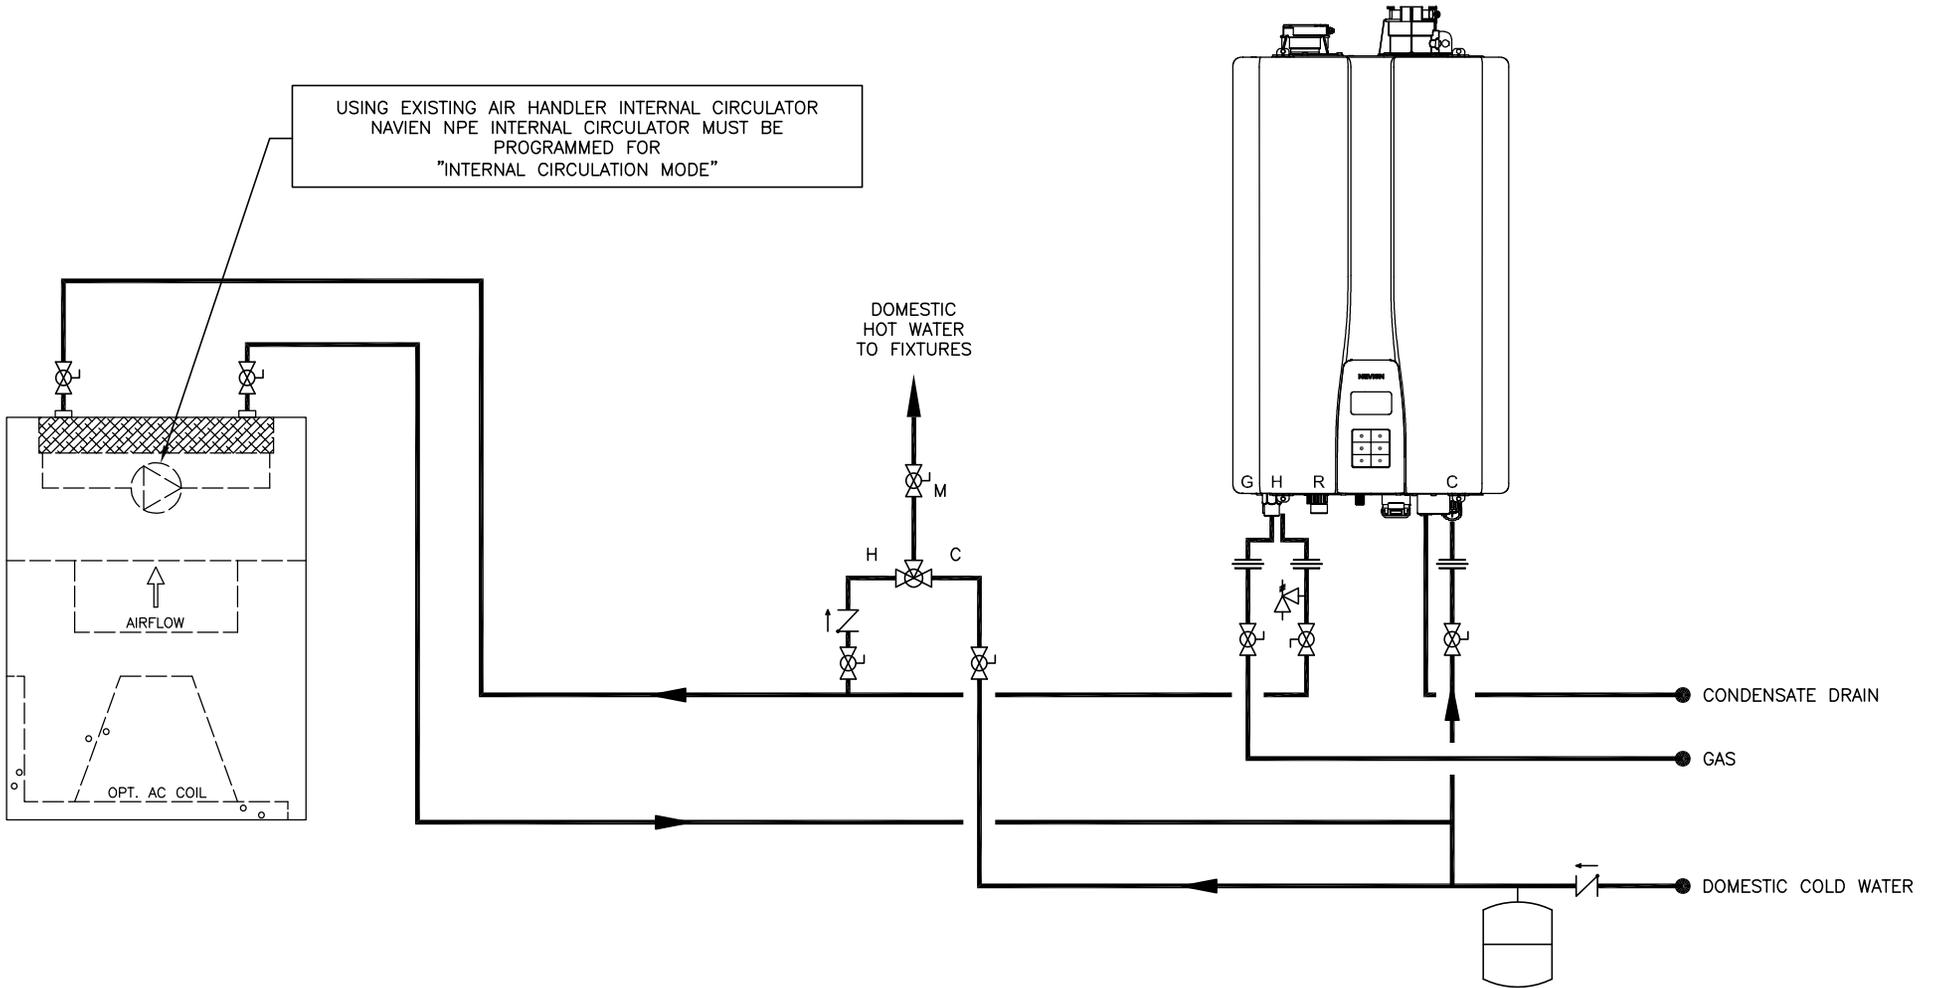

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE

1 UNIT: 3/4"

2 UNITS: 1"

3 UNITS: 1-1/4"

4-5 UNITS: 1-1/2"

6-8 UNITS: 2"

9-14 UNITS: 2-1/2"

15-16 UNITS: 3"


SYMBOL LEGEND



20 GOODYEAR  
 IRVINE, CA 92618  
 800-519-8794  
 www.navienc.com

NPE-A2 SERIES TANKLESS WATER HEATER

NPE-A2 TANKLESS WATER HEATER COMBI WITH AIR HANDLER  
 "APOLLO/HYDROHEAT TANK REPLACEMENT"  
 INCLUDES MODELS 180, 210 AND 240



UNION



CHECK VALVE



FULL-PORT VALVE



MIXING VALVE




AIR HANDLER



PRESSURE RELIEF VALVE



CIRCULATOR



EXPANSION TANK

DRAWN BY:

S. STOEKE

NPE-A2-COMBI-AH

MAY 3, 2022