


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

NOTES:

1. USE NAVIEN CORD P #30011612A
2. PRESS THE MENU BUTTON ON THE FRONT PANEL, AND THEN SELECT 1. RECIRCULATION SETTINGS BY PRESSING THE OK BUTTON. FOR ADDITIONAL SETTINGS & SETUP INSTRUCTIONS PLEASE REFER TO THE INSTALLATION MANUAL.

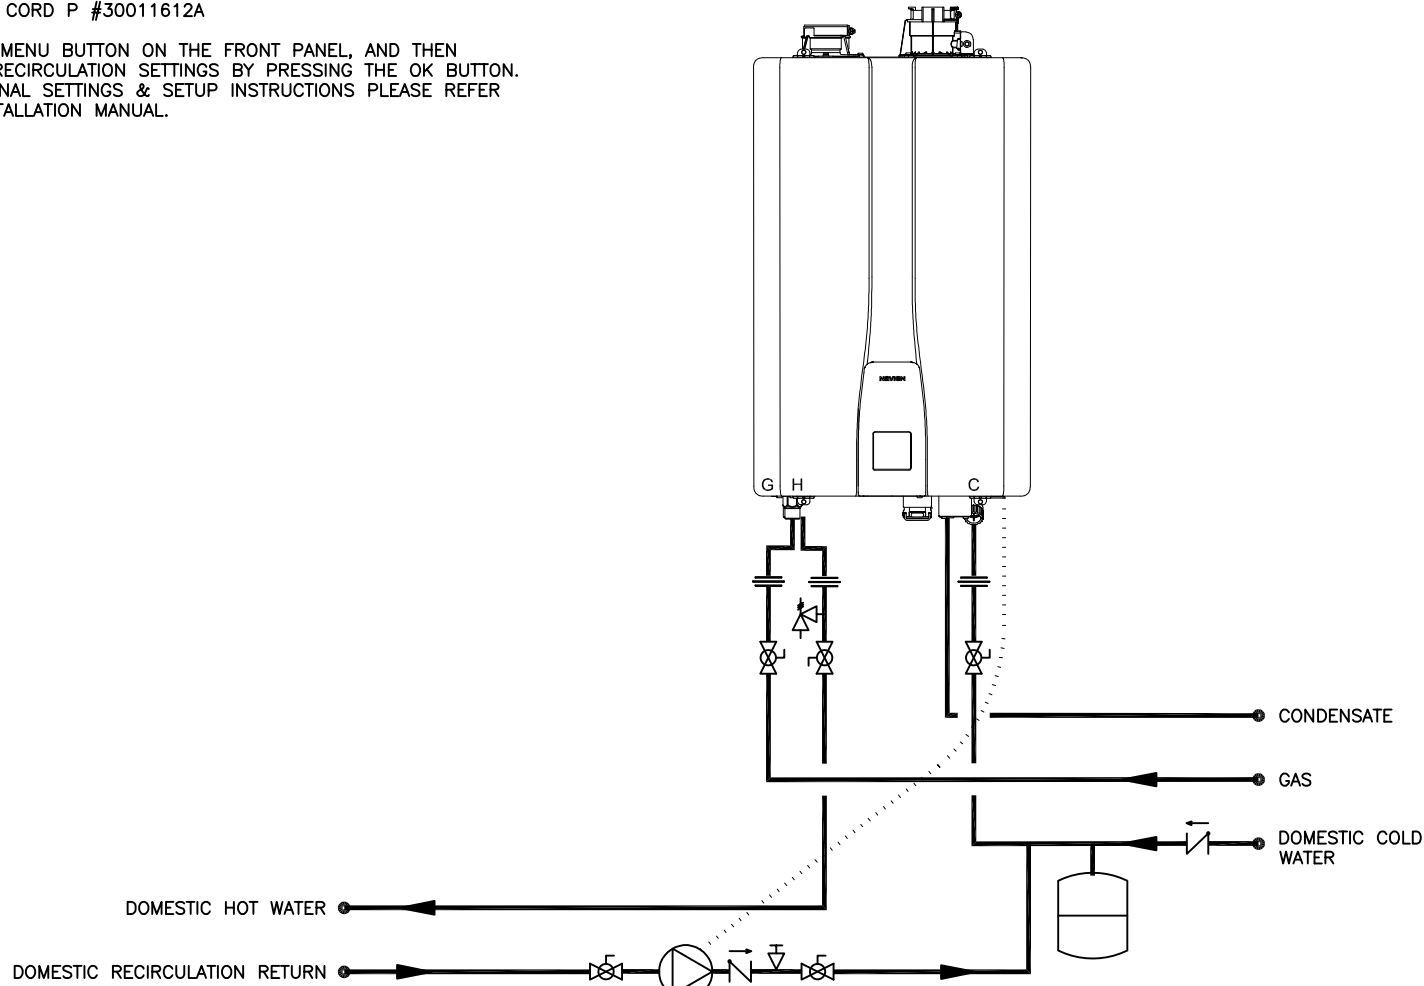

SELECT EXTERNAL CIRCULATOR PERFORMANCE TO BE 2 GPM MINIMUM, 3 GPM MAXIMUM PER TANKLESS BASED ON 11 PSI PRESSURE DROP AT 3 GPM PER TANKLESS, PLUS EXTERNAL BUILDING PIPE, VALVES AND FITTINGS TO ASCERTAIN TOTAL CIRCULATOR PUMP REQUIREMENTS

- CIRCUIT SETTER AT EXTERNAL PUMP IS REQUIRED FOR SETTING MAXIMUM FLOW RATE TO TANKLESS SYSTEM

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"	SYMBOL LEGEND			
NPE-S2 SERIES TANKLESS WATER HEATER								UNION	CHECK VALVE	FULL-PORT VALVE	EXPANSION TANK
(1) NPE-S2 TANKLESS WATER HEATER WITH EXTERNAL RECIRCULATION PUMP SHOWN WITH NAVIEN PUMP WIRE ACCESSORY INCLUDES MODELS 150, 180, 210 AND 240								DHW CIRCULATOR W/ PUMP WIRE AND CHECK VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	BALANCING VALVE
DRAWN BY: S. STOEKE			NPE-S2-1-ECP			MAY 17, 2021					

20 GOODYEAR
IRVINE, CA 92618
800-519-8794
www.navienc.com