


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

- (A) TANKLESS CIRCULATOR (BRONZE OR S.S.) SELECT SHALL BE 12 GPM MAX (4 PER TANKLESS) @ 23' TOTAL HEAD (10 PSI) + PIPE, VALVES, FITTING & TANK
- (B) INSTALL CIRCUIT SETTERS TO MAINTAIN FLOW INTO UNITS @ 4 GPM MAXIMUM

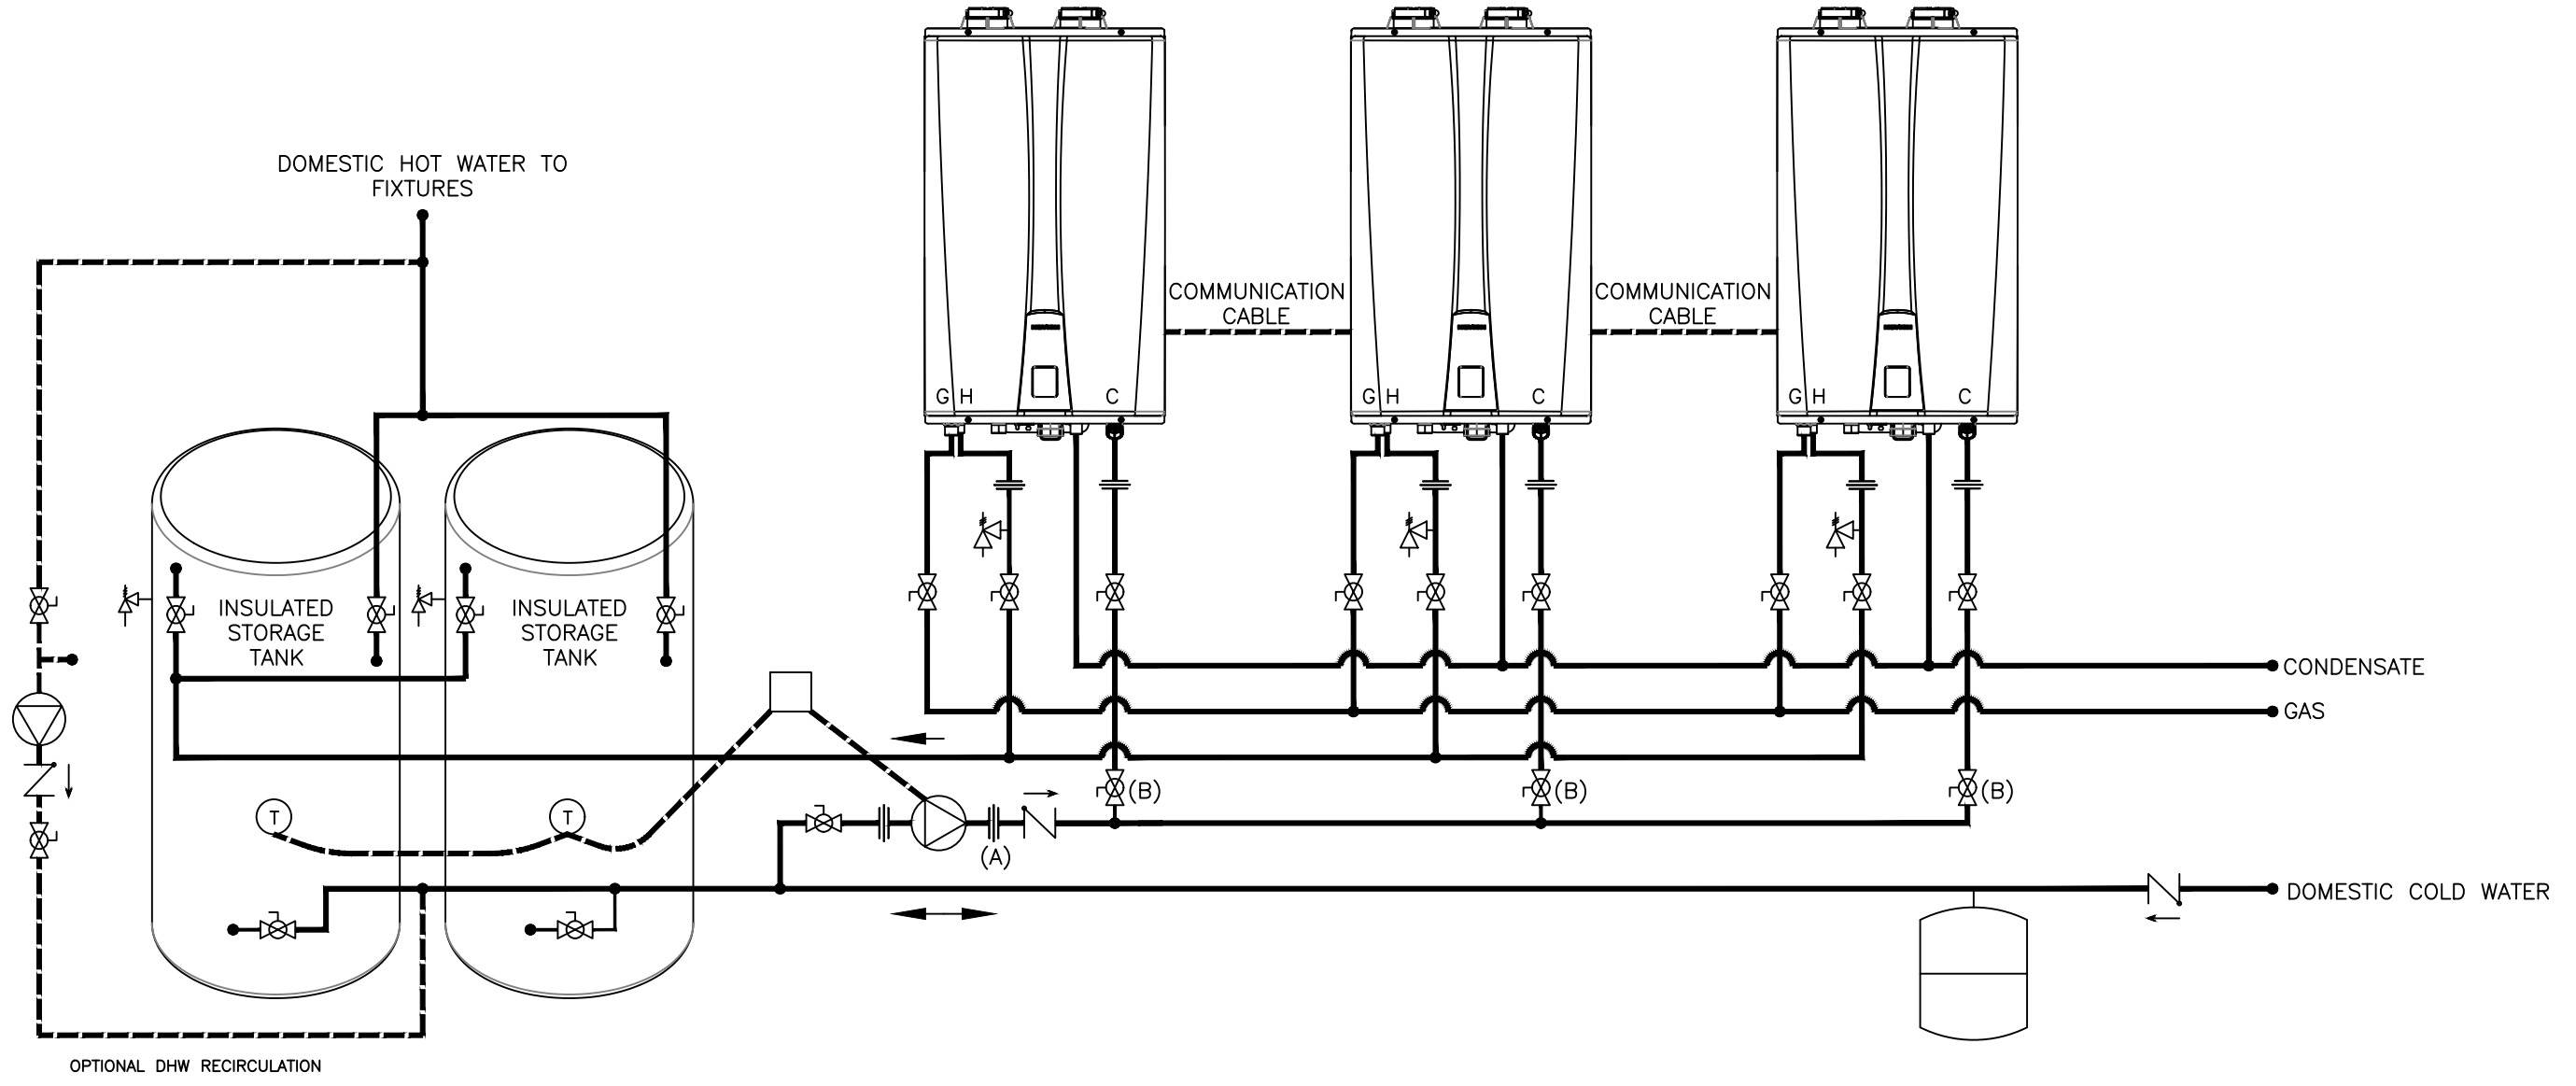

RECOMMENDED PIPE SIZE/HEATER COUNT	1 UNIT - 3/4"	2 UNIT - 1"	3 UNIT - 1-3/4"	4 TO 5 UNITS - 1-1/2"	6 TO 8 UNITS - 2"	9 TO 14 UNITS - 2-1/2"	15 TO 16 UNITS - 3"			
<p>20 GOODYEAR IRVINE, CA 92618 800-519-8794 www.navieninc.com</p>	NPE-S SERIES TANKLESS WATER HEATER						AIR ELIMINATION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
	THREE NPE-S WITH TWO STORAGE TANKS TO MEET FLOW/TEMP RISE REQUIREMENTS						ZONE VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	BACKFLOW PREVENTOR
	DRAWN BY: J.GARCIA	NPE-S-3-2ST-JG01			JULY 17, 2019		DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	MIXING VALVE	EXPANSION TANK	SOLENOID VALVE