


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

- (A) TANKLESS CIRCULATOR (BRONZE OR SS) SELECTED CIRCULATOR SHALL BE 12 GPM MAXIMUM (3 TANKLESS, 4 PER TANKLESS) @ 23' TOTAL HEAD (10 PSI) + PIPE, VALVES, FITTINGS & TANK.
- (B) INSTALL CIRCUIT SETTERS TO MAINTAIN FLOW INTO UNITS @ 4 GPM MAXIMUM.

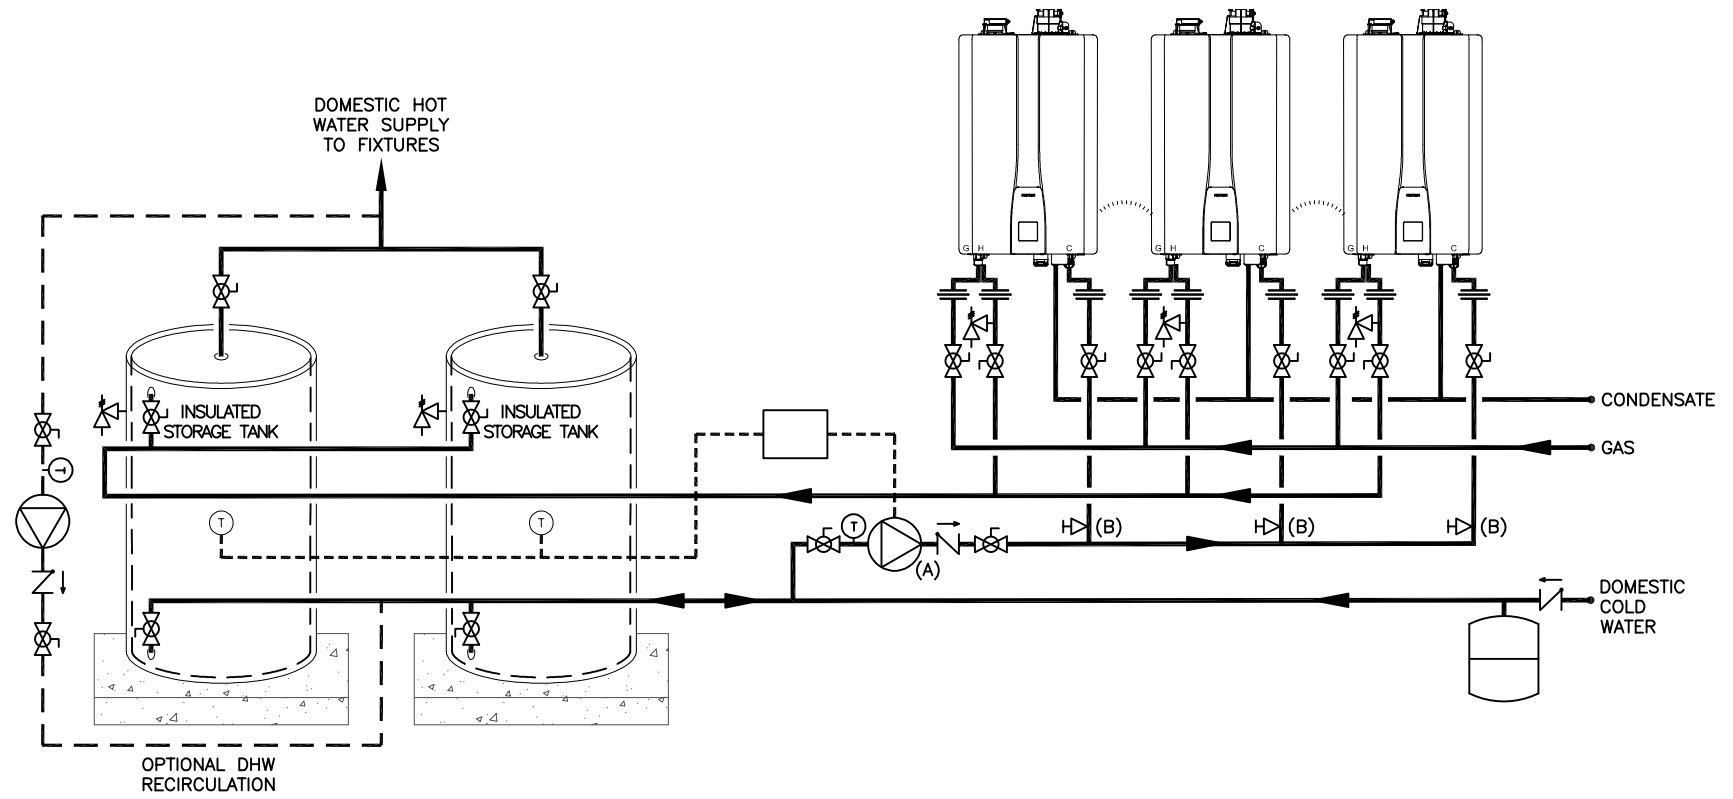

Navien
 20 GOODYEAR
 IRVINE, CA 92618
 800-519-8794
 www.navienc.com

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"
NPE-S2 SERIES TANKLESS WATER HEATER							
(3) NPE-S2 TANKLESS WATER HEATERS WITH (2) STORAGE TANKS TO MEET FLOW/TEMP RISE REQUIREMENT INCLUDES MODELS 150, 180, 210 AND 240							
DRAWN BY:	S. STOEKE	NPE-S2-3-ST-2			MAY 17, 2021		

SYMBOL LEGEND			
	UNION		CHECK VALVE
	FULL-PORT VALVE		AQUASTAT
	CONTROL WIRING		PRESSURE RELIEF VALVE
	CIRCULATOR		EXPANSION TANK
	CASCADE CABLE		BALANCING VALVE
	CIRCULATOR ZONE PANEL		