


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

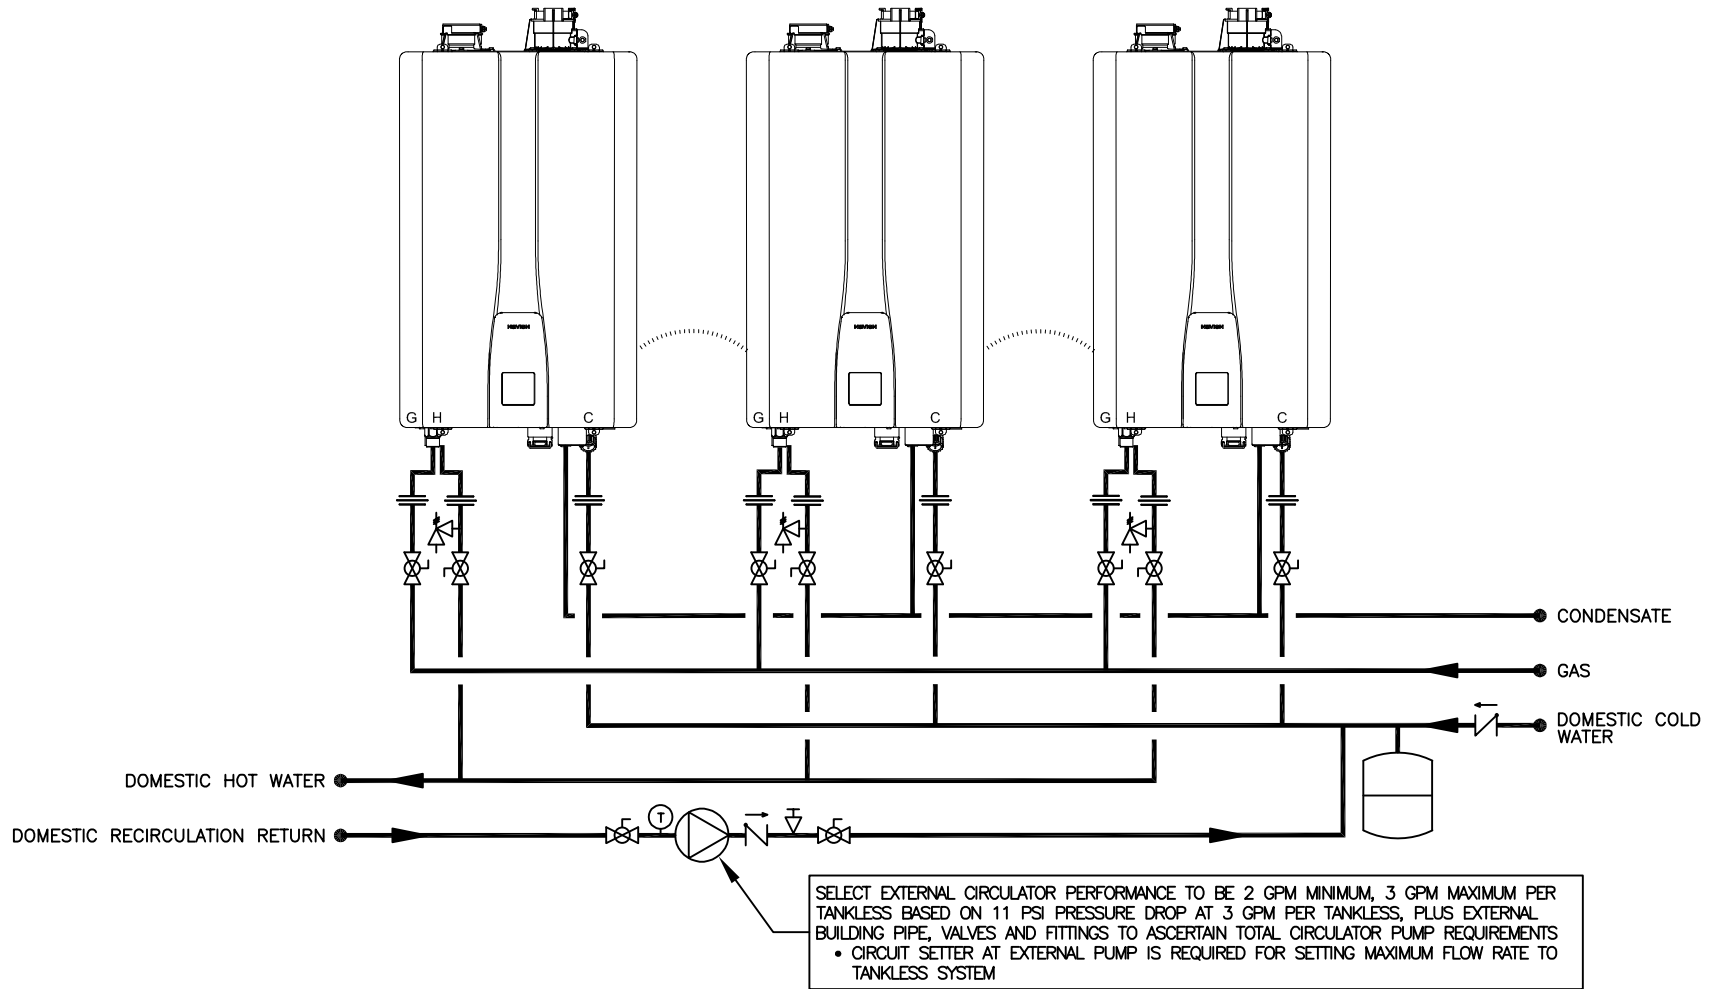

SELECT EXTERNAL CIRCULATOR PERFORMANCE TO BE 2 GPM MINIMUM, 3 GPM MAXIMUM PER TANKLESS BASED ON 11 PSI PRESSURE DROP AT 3 GPM PER TANKLESS, PLUS EXTERNAL BUILDING PIPE, VALVES AND FITTINGS TO ASCERTAIN TOTAL CIRCULATOR PUMP REQUIREMENTS

- CIRCUIT SETTER AT EXTERNAL PUMP IS REQUIRED FOR SETTING MAXIMUM FLOW RATE TO TANKLESS SYSTEM

TANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4"	2 UNITS: 1"	3 UNITS: 1-1/4"	4-5 UNITS: 1-1/2"	6-8 UNITS: 2"	9-14 UNITS: 2-1/2"	15-16 UNITS: 3"
------------------------------------------	--------------	-------------	-----------------	-------------------	---------------	--------------------	-----------------

SYMBOL LEGEND

20 GOODYEAR
IRVINE, CA 92618
800-519-8794
www.navienc.com

NPE-S2 SERIES TANKLESS WATER HEATER

(3) NPE-S2 TANKLESS WATER HEATERS
WITH EXTERNAL RECIRCULATION PUMP
INCLUDES MODELS 150, 180, 210 AND 240

DRAWN BY: S. STOEKE

NPE-S2-3-ECP

MAY 17, 2021

UNION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
DHW CIRCULATOR W/ AQUASTAT, OPTIONAL TIMER & CHECK VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	EXPANSION TANK
CASCADE CABLE	BALANCING VALVE		