


THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPLIANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION.

NOTES: UNLESS OTHERWISE SPECIFIED

1. (A) TANKLESS CIRCULATOR (BRONZE OR S.S.) SELECT SHALL BE 32 GPM MAX (4 PER TANKLESS) @ 23' TOTAL HEAD (10 PSI) + PIPE, VALVES, FITTING & TANK
2. (B) INSTALL CIRCUIT SETTERS TO MAINTAIN FLOW INTO UNITS @ 4 GPM MAXIMUM.
3. COMMUNICATION CABLE IS ABBREVIATED BY C.C.

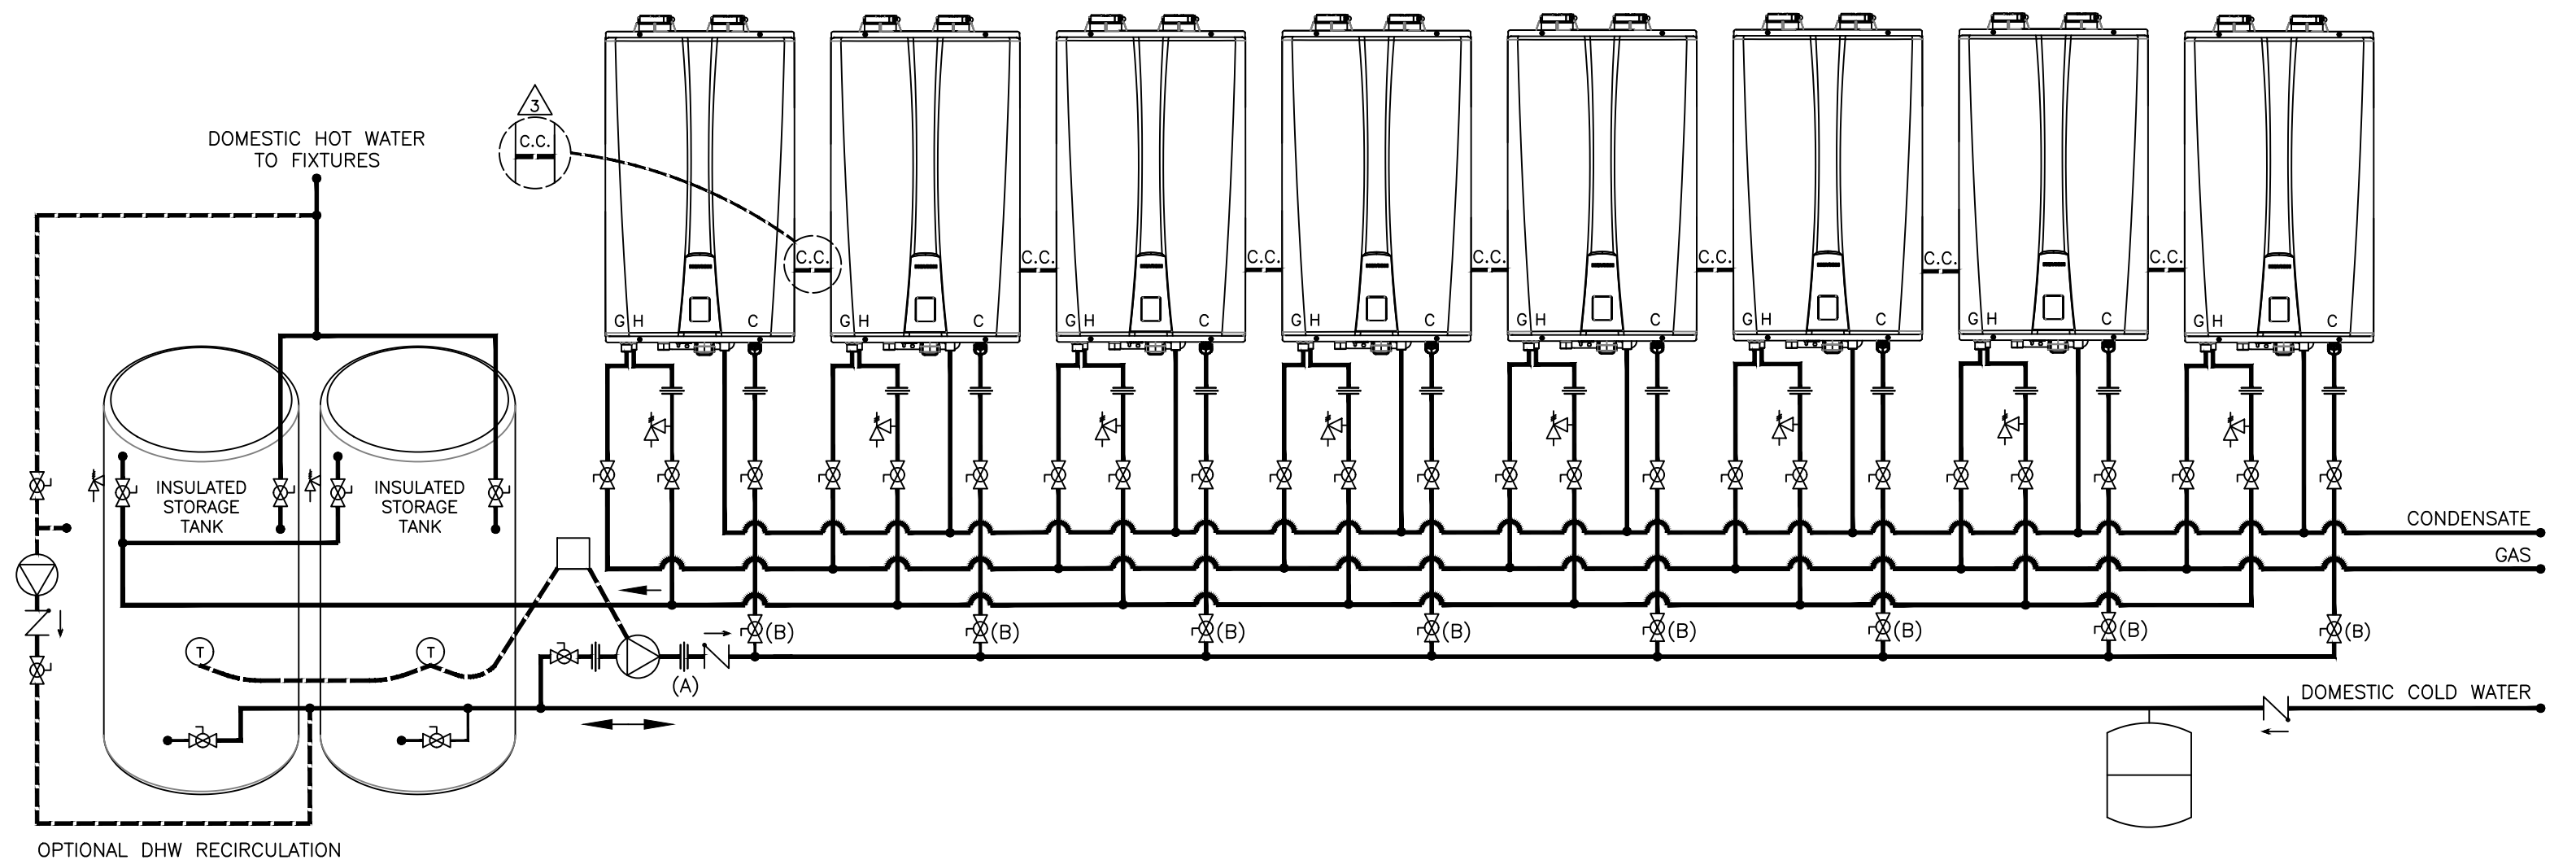

RECOMMENDED PIPE SIZE/HEATER COUNT	1 UNIT - 3/4"	2 UNIT - 1"	3 UNIT - 1-3/4"	4 TO 5 UNITS - 1-1/2"	6 TO 8 UNITS - 2"	9 TO 14 UNITS - 2-1/2"	15 TO 16 UNITS - 3"
------------------------------------	---------------	-------------	-----------------	-----------------------	-------------------	------------------------	---------------------



20 GOODYEAR  
IRVINE, CA 92618  
800-519-8794  
www.navieninc.com

NPE-S SERIES TANKLESS WATER HEATER  
EIGHT NPE-S WITH TWO STORAGE TANKS  
TO MEET FLOW/TEMP RISE REQUIREMENTS

DRAWN BY: J.GARCIA

NPE-S-8-2ST-JG01

JULY 17, 2019

AIR ELIMINATION	CHECK VALVE	FULL-PORT VALVE	AQUASTAT
ZONE VALVE	PRESSURE RELIEF VALVE	CIRCULATOR	BACKFLOW PREVENTOR
DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	MIXING VALVE	EXPANSION TANK	SOLENOID VALVE