




FIELD SUPPLIED CIRCULATOR ZONE PANEL SHALL HAVE DRY CONTACTS CLOSED ON HEAT CALLS WIRED TO NAVIEN NCB UNIT "T & T" TERMINALS TO ACTIVATE HEAT MODE DIP Sw 7 OF 8 Down (OFF) ON PCB

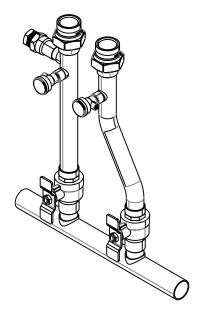



CONDENSATE HYDRONIC FEED WATER

DOMESTIC COLD WATER DOMESTIC HOT WATER GAS



)	AIR ELIMINATION	12	CHECK VALVE	L-Port Valve	Ţ)	AQUASTAT
]~	ZONE VALVE		PRESSURE RELIEF VALVE	CULATOR		
) →N	DHW CIRCULATOR W/AQUASTAT & CHECK VALVE	Ø	MIXING VALVE	PANSION TANK	Æ	SOLENOID VALVE