
THIS DRAWING IS INTENDED ONLY AS A GUIDE AND NOT AS A REPLACEMENT FOR PROFESSIONALLY ENGINEERED PROJECT DRAWINGS. THIS CONCEPT SYSTEM DRAWING DOES NOT IMPLY COMPULANCE WITH LOCAL BUILDING CODES. ACTUAL INSTALLATION MAY VARY DEPENDING ON INSTALLATION LOCATION AND PARAMETERS AND IT MUST BE DONE IN ACCORDANCE TO ALL LOCAL BUILDING CODES. VERIFY WITH LOCAL BUILDINGS OFFICIALS BEFORE COMMENCEMENT OF SYSTEM INSTALLATION. CHANGES OR MODIFICATIONS TO PIPING OR DESIGN IS NOT TO BE PERFORMED WITHOUT EXPRESSED WRITTEN PERMISSION BY NAVIEN, INC.

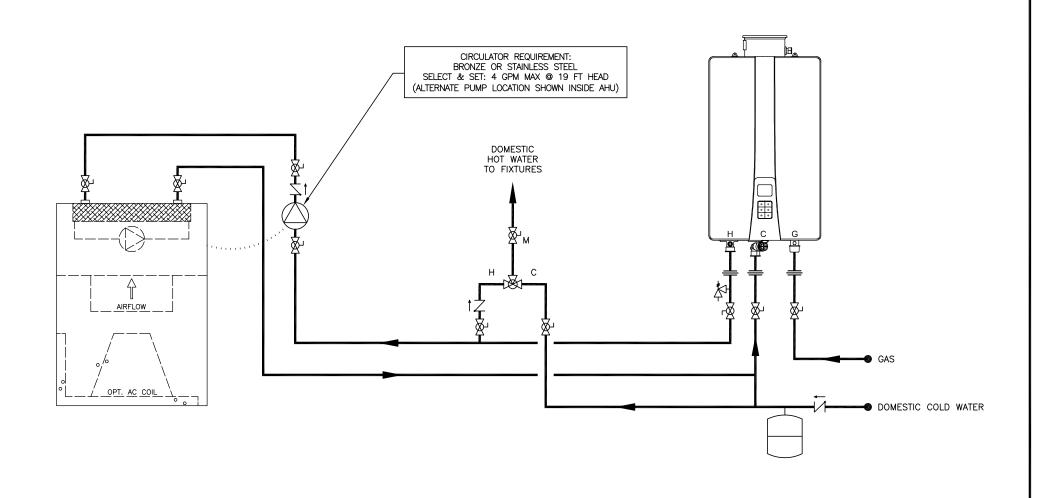

L	ANKLESS QUANTITY: RECOMMENDED PIPE SIZE	1 UNIT: 3/4" 2 UNITS: 1" 3 UNITS: 1-1/4" 4-5 UNITS: 1-1/2" 6-8 UNITS: 2" 9-14 UNITS: 2-1/2" 15-16 UNITS: 3"					SYMBOL LEGEND						
		NPN-U SERIES TANKLESS WATER HEATER						=	UNION		CHECK VALVE	FULL-PORT VALVE	MIXING VALVE
	MNGVICN	NPN-U TANKLESS WATER HEATER COMBI WITH AIR HANDLER								' '			1
	20 GOODYEAR IRVINE. CA 92618		111 11 0	INCLUDES MODELS 16				AIR HANDLER PRESSURE RELIEF - CI		-CIRCULATOR	ATOR EXPANSION TANK		
	800-519-8794												
L	www.navieninc.com	DRAWN BY: S. ST	OEKE	NPN-U-COME	-AH	APRI	L 29, 2022						